

**TECHNICAL DATA** 

## Fluke MDA-510 and MDA-550 **Motor Drive Analyzer**











#### **KEY MEASUREMENTS**

Inverter output voltage, DC bus voltage and ripple voltage, harmonics, unbalance

### THREE POWERFUL TEST TOOLS IN

Motor-drive analyzer, waveform analyzer and recording data logger all in one

#### **HIGHEST SAFETY RATING IN THE INDUSTRY**

600 V CAT IV/1000 V CAT III rated for use at the service entrance and downstream

#### Simplify complex motor-drive troubleshooting with guided test setups and automated drive measurements that provide reliable, repeatable test results.

The new Fluke MDA 510 and MDA 550 Motor-Drive Analyzers save time and eliminate the hassle of setting up complex measurements, while simplifying the troubleshooting process. Simply select a test and the step-by-step guided measurements show you where to make voltage and current connections, while the preset measurement profiles ensure you will capture all the data you need for each critical motor-drive section-from the input to the output, the DC bus, and the motor itself. From basic to advanced measurements, the MDA-500 Series has you covered, and with a built-in report generator you can quickly and easily generate as-found, and as-left reports with confidence.

The MDA-510 and MDA-550 are the ideal portable motor-drive analysis test tools, and can help safely locate and troubleshoot typical problems on inverter type motor-drive systems.

- Measure key motor-drive parameters including voltage, current, DC Bus voltage level and AC ripple, voltage and current unbalance and harmonics (MDA-550), voltage modulation, and motor shaft voltage discharges (MDA-550).
- Perform extended harmonics measurements to identify the effects of low and high order harmonics on your electrical power system.
- Conduct guided measurements for motor-drive input, DC bus, drive output, motor input and shaft measurements (MDA-550) with graphical step-by-step voltage and current connection diagrams.
- Use simplified measurement setup with preset measurement profiles to automatically trigger data collection based on the chosen test procedure.
- Create reports quickly and easily that are perfect for documenting troubleshooting and collaborative work with others.
- Measure additional electrical parameters with full 500 MHz oscilloscope, meter and recording capability for complete range of electrical and electronic measurement on industrial systems.



# The Fluke MDA-510 and MDA-550 Motor Drive Analyzers use guided test measurements to make analysis easier than ever

#### **Drive input**

Measure input voltage and current to quickly see whether values are within acceptable limits by comparing the drive's nominal rated voltage to the actual supplied voltage. Then, check the input current to determine if the current is within the maximum rating and the conductors are suitably sized. You can also check whether the harmonic distortion is within an acceptable level by visually inspecting the waveform shape or by viewing the harmonics spectrum screen (MDA-550) which shows both the total harmonic distortion and individual harmonics.

#### Voltage and current unbalance

Check the voltage unbalance at the input terminals so you can ensure the phase unbalance is not too high (> 6-8 %), and that the phase rotation is correct. You can also check the current unbalance, as excessive unbalance may indicate a drive rectifier problem.

#### **Extended harmonic measurements**


Excessive harmonics are not just a threat to your rotating machines but also to other equipment connected to the electrical power system. The MDA-550 provides the ability to discover the harmonics of the motor-drive but can also discover the possible effects of inverter switching electronics. The MDA-550 has three harmonic ranges, 1st to 51st Harmonics, 1 to 9 kHz and 9 kHz to 150 kHz giving the ability to detect any harmonic pollution problems.

#### DC bus


In a motor-drive the conversion of AC to DC inside the drive is critical, having the correct voltage and adequate smoothing with low ripple is required for the best drive performance. High ripple voltage may be an indicator of failed capacitors or incorrect sizing of the connected motor. The record function of the MDA-500 Series can be used to check DC bus performance dynamically in the operating mode while a load is applied.

#### **Drive output**


Check the output of the drive focusing both on voltage to frequency ratio (V/F), and voltage modulation. When high V/F ratio measurements are experienced, the motor may overheat. With low V/F ratios, the connected motor may not be able to provide the required torque at the load to sufficiently run the intended process.

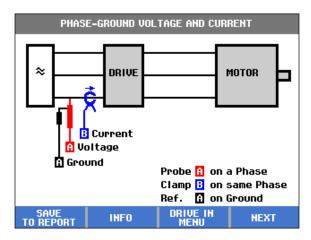

Drive input step-by-step guided measurement connections

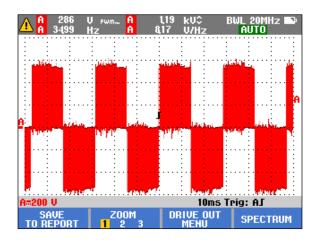

Drive output waveform with auto triggering

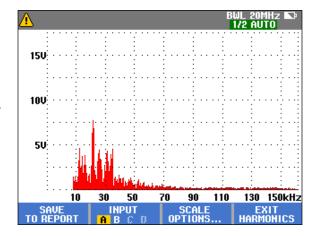

Extended harmonics spectrum from 9 kHz to 150 kHz



#### **Voltage modulation**

Measurements of the Pulse Width Modulated signal are used to check for high voltage peaks which can damage motor winding insulation. The rise time or steepness of impulses is indicated by the dV/dt reading (rate of voltage change over time), this should be compared to the motor's specified insulation. The measurements can also be used to measure switching frequency to identify whether there is a potential issue with electronic switching, or with grounding, where the signal floats up and down.

#### **Motor input**


Ensuring that voltage is being supplied at the motor input terminals is key, and the selection of cabling from drive to the motor is critical. Incorrect cabling selection can result in both drive and motor damage due to excessive reflected voltage peaks. Checking that the current present at the terminals is within the motor rating is important as over current condition could cause the motor to run hot, decreasing the life of the stator insulation which can result in the early failure of the motor.

#### Motor shaft voltage


Voltage pulses from a variable speed drive can couple from a motor's stator to its rotor, causing a voltage to appear on the rotor shaft. When this rotor shaft voltage exceeds the insulating capacity of the bearing grease, flashover currents (sparking) can occur, causing pitting and fluting of the motor bearing race, damage that can cause a motor to fail prematurely. The MDA-550 Series analyzers are supplied with carbon fiber brush probe tips that can easily detect the presence of destructive flashover currents, while the impulse amplitude and count of events will enable you to take action before failure occurs. The addition of this accessory and capability of the MDA-550 allows you to discover potential damage without investing in expensive permanently installed solutions.

## Step-by-step guided measurements ensure you have the data vou need, when you need it

The MDA-500 Series is designed to help you quickly and easily test and troubleshoot typical problems on three-phase and single-phase inverter type motor-drive systems. The on-screen information, and step-by-step setup guidance make it easy to configure the analyzer and get the drive measurements you need to make better maintenance decisions, fast. From power input to the installed motor, the MDA-500 provides the measurement capability for the fastest motor-drive troubleshooting.

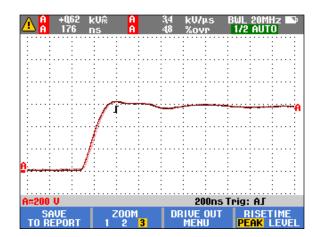

Voltage modulation with zoom

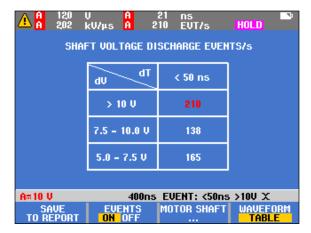


Motor shaft voltage discharge event counts



#### Quick and easy measurement setup




1) Press 'Motor Drive Analyzer' button and select 'Drive Measurement Location'.

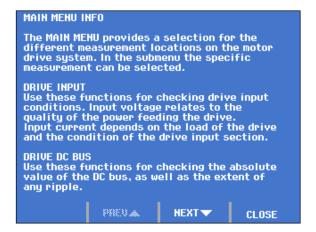


Use the on-screen context information to further guide you to successful setup and measurement.




3) Choose the measurement.



4) Select the measurement method/option.

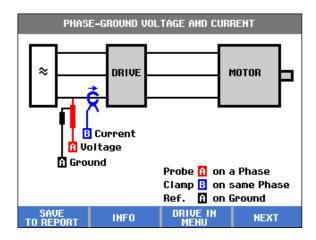

Connect the test probes according to the diagram. Once complete press 'Next'.

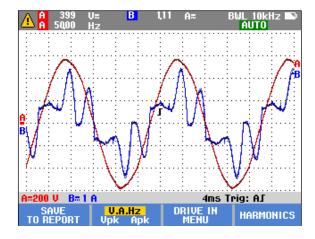


6) The analyzer will then automatically trigger, and configure the reading for the optimum measurements.




#### Reporting and analysis

The MDA-500 Series simplifies the process of gathering data and writing test reports with a built-in report generator.

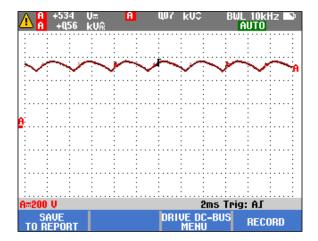

At each test point or measurement there is the option to create, update or modify a report. Simply press 'SAVE TO REPORT' and select the appropriate screens to save into a text based report file.

By performing the step-by-step guided measurements a comprehensive report can be created directly from the instrument to document the entire troubleshooting process.

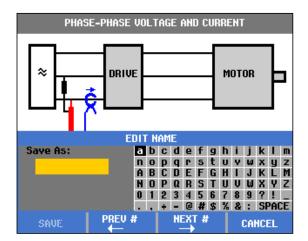

Input the report name. The single report encompasses all recorded measurements and can easily be shared with other users and used for motordrive benchmarking, and for comparing data now and in the future.



#### **Featured measurements**

Measurement and Analysis Combinations					
Test point	Sub group	Reading 1	Reading 2	Reading 3	Reading 4
Motor drive input					
Voltage and current					
Phase-phase	V-A-Hz	V ac+dc	A ac+dc	Hz	
	V peak	V peak max	V peak min	V pk-to-pk	Crest factor
	A peak	A peak max	A peak min	A pk-to-pk	Crest factor
Phase-ground	V-A-Hz	V ac+dc	A ac+dc	Hz	
	V peak	V peak max	V peak min	V pk-to-pk	Crest factor
	A peak	A peak max	A peak min	A pk-to-pk	Crest factor
Voltage unbalance	Unbalance	V ac+dc	V ac+dc	V ac+dc	Unbalance
	Peak	V pk-to-pk	V pk-to-pk	V pk-to-pk	
Current unbalance	Unbalance	A ac+dc	A ac+dc	A ac+dc	Unbalance
	Peak	A pk-to-pk	A pk-to-pk	A pk-to-pk	
Motor drive DC bus					
DC		V dc	V pk-to-pk	V peak max	
Ripple		V ac	V pk-to-pk	Hz	
Motor drive output					
Voltage and current (filtered)	V-A-Hz	V PWM	A ac+dc	Hz	V/Hz
	V peak	V peak max	V peak min	V pk-to-pk	Crest factor
	A peak	A peak max	A peak min	A pk-to-pk	Crest factor
Voltage unbalance	Unbalance	V PWM	V PWM	V PWM	Unbalance
	Peak	V pk-to-pk	V pk-to-pk	V pk-to-pk	
Current unbalance	Unbalance	A ac+dc	A ac+dc	A ac+dc	Unbalance
	Peak	A pk-to-pk	A pk-to-pk	A pk-to-pk	
Voltage modulation	'	'		•	•
Phase-phase	Zoom 1	V PWM	V pk-to-pk	Hz	V/Hz
	Zoom 2	V peak max	V peak min	Delta V	
	Zoom 3 peak	V peak max	Delta V/s	Risetime peak	Overshoot
	Zoom 3 level	Delta V	Delta V/s	Risetime level	Overshoot
Phase-ground	Zoom 1	V PWM	V pk-to-pk	V peak max	V peak min
	Zoom 2	V Peak max	V peak min	Delta V	Hz
	Zoom 3 peak	V Peak max	Delta V/s	Risetime peak	Overshoot
	Zoom 3 level	Delta V	Delta V/s	Risetime level	Overshoot
Phase-DC +	Zoom 1	V PWM	V pk-to-pk	V Peak max	V peak min
	Zoom 2	V peak max	V peak min	Delta V	Hz
	Zoom 3 peak	V peak max	Delta V/s	Risetime peak	Overshoot
	Zoom 3 level	Delta V	Delta V/s	Risetime level	Overshoot



Phase-DC -	Zoom 1	V PWM	V pk-to-pk	V peak max	V peak min
	Zoom 2	V peak max	V peak min	Delta V	Hz
	Zoom 3 peak	V peak max	Delta V/s	Risetime peak	Overshoot
	Zoom 3 level	Delta V	Delta V/s	Risetime level	Overshoot
Motor input					
Voltage and current (filtered)	V-A-Hz	V PWM	A ac+dc	Hz	V/Hz
	V peak	V peak max	V peak min	V pk-to-pk	Crest factor
	A peak	A peak max	A peak min	A pk-to-pk	Crest factor
Voltage unbalance	Unbalance	V PWM	V PWM	V PWM	Unbalance
	Peak	V pk-to-pk	V pk-to-pk	V pk-to-pk	
Current unbalance	Unbalance	A ac+dc	A ac+dc	A ac+dc	Unbalance
	Peak	A pk-to-pk	A pk-to-pk	A pk-to-pk	
Voltage modulation					
Phase-phase	Zoom 1	V PWM	V pk-to-pk	Hz	V/Hz
	Zoom 2	V peak max	V peak min	Delta V	
	Zoom 3 peak	V peak max	Delta V/s	Risetime peak	Overshoot
	Zoom 3 level	Delta V	Delta V/s	Risetime level	Overshoot
Phase-ground	Zoom 1	V PWM	V pk-to-pk	V peak max	V peak min
	Zoom 2	V peak max	V peak min	Delta V	Hz
	Zoom 3 peak	V peak max	Delta V/s	Risetime peak	Overshoot
	Zoom 3 level	Delta V	Delta V/s	Risetime level	Overshoot
MDA 550 only					
Motor shaft	_				
Shaft voltage	Events off	V pk-to-pk			
	Events on	Delta V	Rise/fall time	Delta V/s	Events/s
Motor drive input, out	put and motor input				
Harmonics	Voltage	V ac	V fundamental	Hz fundamental	% THD
	Current	A ac	A fundamental	Hz fundamental	% THD/TDD



#### **Specifications**

Measurement Function	Specification
DC voltage (V dc)	
Maximum voltage with 10:1 or 100:1 probe	1000 V
Maximum resolution with 10:1 or 100:1 probe	1 mV
Full scale reading	999 counts
Accuracy at 4 s to 10 us/div	± (3 % + 6 counts)
AC voltage (V ac)	
Maximum voltage with 10:1 or 100:1 probe	1000 V
Maximum resolution with 10:1 or 100:1 probe	1 mV
Full scale reading	999 counts
50 Hz	± (3 % + 10 counts) - 0.6 %
60 Hz	± (3 % + 10 counts) - 0.4 %
60 Hz to 20 kHz	± (4 % + 15 counts)
20 kHz to 1 MHz	± (6 % + 20 counts)
1 MHz to 25 MHz	± (10 % + 20 counts)
True-rms voltage (V ac+dc)	
Maximum voltage with 10:1 or 100:1 probe	1000 V
Maximum resolution with 10:1 or 100:1 probe	1 mV
Full scale reading	1100 counts
DC to 60 Hz	± (3 % + 10 counts)
60 Hz to 20 kHz	± (4 % + 15 counts)
20 kHz to 1 MHz	± (6 % + 20 counts)
1 MHz to 25 MHz	± ( 10 % + 20 counts)
PWM voltage (V pwm)	
Purpose	To measure on pulse width modulated signals, like motor drive inverter outputs
Principle	Readings show the effective voltage based on the average value of samples over a whole number of periods of the fundamental frequency
Accuracy	As Vac+dc for sinewave signals
Peak voltage (V peak)	
Modes	Max peak, min peak, or pk-to-pk
Maximum voltage with 10:1 or 100:1 probe	1000 V
Maximum resolution with 10:1 or 100:1 probe	10 mV
Accuracy	
Max peak, min peak	± 0.2 division
Pk-to-pk	± 0.4 division
Full scale reading	800 counts



Ranges Scale Pactors O. 1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50mV/A, 100 mV/A, 200 mV/A, 400 mV/A Accuracy Same as Vac, Vac+dc or V peak (add current clamp accuracy)  Trequency [Kr]  Range 1.000 Hz to 500 MHz Pull scale reading 999 counts Accuracy ± (0.5 % + 2 counts)  Voltage later ratio (V/Hz)  Purpose To show the measured V PWM value [see V PWM] divided by the fundamental frequency on variable ace motor speed drives Accuracy % Vrms + % Hz  Voltage unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages Accuracy Indicative percentage based on Vac+dc values  Voltage unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Accuracy Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Accuracy Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Asc+dc values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Asc+dc values  Rice and full time  Radings Voltage difference (dV), time difference (dV),	Comment (ERED) with more at all and	
Scale Factors 0.1 mV/A, 1 mW/A, 20 mV/A, 20 mV/A, 20 mV/A, 400 mV/A, 400 mV/A Accuracy Same as Vac, Vac+de or V peak (add current clamp accuracy)  Frequency (Hz)  Range 1.000 Hz to 500 MHz  999 counts  Accuracy ± (0.5 % + 2 counts)  Voltage/Inter ratio (V/Hz)  Purpose To show the measured V PWM value (see V PWM) divided by the fundamental frequency on variable ac motor speed drives  Accuracy % VFms + % Hz  Voltage unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages  Accuracy Indicative percentage based on Vac+dc values  Voltage unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages landcative percentage based on V PWM value.  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and proving the prov	Current (AMP) with current clamp	Company Van Van de er Van de
Accuracy  Same as Vac, Vac+dc or V peak (add current clamp accuracy)  Frequency (Itz)  Range  1,000 Hz to 500 MHz  Pull scale reading  Accuracy  \$1,05 % + 2 counts)  Voltage/Here ratio [V/Hz)  Purpose  To show the measured V PWM value (see V PWM) divided by the fundamental frequency on variable ac motor speed drives  Accuracy  Voltage unbalance drive input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages  Accuracy  Indicative percentage based on Vac+dc values  Voltage unbalance drive output and motor input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages accuracy  Indicative percentage based on V PWM values  Current unbalance drive input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages accuracy  Indicative percentage based on V PWM values  Current unbalance drive input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy  Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy  Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy  Indicative percentage based on A ac values  To show the highest percentage based on Accuracy to the state of the phase vs average of the 3 AC current values  Accuracy  Accuracy  To show the highest percentage based on Accuracy to the state of the phase vs average of the 3 AC current values  Accuracy  To show the highest percentage based on Accuracy to the phase vs average of the 3 AC current values  Accuracy  To show the highest percentage based on Accuracy to the phase vs average of the 3 AC current values  Accuracy  To show the highest	•	•
Range 1.000 Hz to 500 MHz  Full scale reading 999 counts  Accuracy ± [0.5 % + 2 counts)  Voltage/Herz ratio (V/Hz)  Purpose To show the measured V PWM value [see V PWM] divided by the fundamental frequency on variable ac motor speed drives  Accuracy % Vrms + % Hz  Voltage unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages  Accuracy Indicative percentage based on Vac+de values  Voltage unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Indicative percentage based on Acc+de values  Accuracy Indicative percentage based on Acc+de values  Current unbalance drive output and indicative percentage based on Acc+de values  Accuracy To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Acc+de values  Current unbalance drive output and indicative percentage based on Acc+de values  Accuracy Indicative percentage based on Acc+de values  Current unbalance drive output and indicative percentage based on Acc+de values  Accuracy To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Acc values  Rise and full time  Readings Accuracy Accuracy Indicative percentage based on Accuracy Ac		
Range 1.000 Hz to 500 MHz Full seale reading 999 counts Accuracy ± (0.5 % + 2 counts)  Voltage/Herz ratio (V/Hz)  Purpose To show the measured V PWM value (see V PWM) divided by the fundamental frequency on variable ac motor speed drives Accuracy % vrms + % Hz  Voltage unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages Accuracy Indicative percentage based on Vac+dc values  Voltage unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Accuracy Indicative percentage based on VPWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Accuracy Indicative percentage based on Ac+dc values  Accuracy Indicative percentage based on Ac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Ac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Ac+dc values  Accuracy Indicative percentage based on Ac values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot Accuracy Ac socioloscope accuracy  Harmonics Accuracy Ac socioloscope accuracy  Harmonics DC to Sist  Spectrum ranges D. 1. 9 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Voltage Probe Gettings  Voltage Probe Li, 1.01, 100:1, 1000:1, 20:1, 200:1	•	Same as Vac, Vac+dc or V peak (add current clamp accuracy)
Full scale reading 999 counts  Accuracy ± (0.5 % + 2 counts)  Voltage/Hiroz ratio (V/Hz)  Purpose To show the measured V PWM value (see V PWM) divided by the fundamental frequency on variable ac motor speed drives  Accuracy % Wrms + % Hz  Voltage unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages  Accuracy Indicative percentage based on Vac+dc values  Voltage unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages accuracy Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Acc+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Acc+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Acc+dc values  Current unbalance drive output and motor input  Purpose Voltage difference (dV), time difference (dI), voltage vs time difference (dV/dI), overshoot Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to 51st  Spectrum ranges DC to 51st  Spectrum ranges Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Wimber of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Description of the phase vs average of the 3 AC current Purpose (dV/dI), 1 mV/A, 1 mV/A, 1 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A		
Accuracy	•	
Voltage /Herz ratio (V/Hz)  Purpose  To show the measured V PWM value (see V PWM) divided by the fundamental frequency on variable ac motor speed drives  Accuracy  9e Vrms + 9e Hz  Voltage unbalance drive input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages  Accuracy  Indicative percentage based on Vac+dc values  Voltage unbalance drive output and motor input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages indicative percentage based on V PWM values  Current unbalance drive input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages indicative percentage based on V PWM values  Current unbalance drive input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose  To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy  Indicative percentage based on A ac values  Rise and fall time  Readings  Voltage difference (dV), time difference (dt), voltage vs time difference (dV)dt), overshoot  Accuracy  As oscilloscope accuracy  Harmonics  DC to 51st  Spectrum ranges  Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC  Probe settings  Voltage Probe  1:1, 10:1, 100:1, 100:1, 20:1, 20:1, 20:1  Current Clamp  Output  DC to 1:1, 10:1, 100:1, 100:1, 20:1, 20:1  Current Clamp  DC to 1:1, 10:1, 100:1, 100:1, 20:1, 20:1  Current Clamp  Output  DC to 1:1, 10:1, 100:1, 100:1, 20:1, 20:1		
Purpose To show the measured V PWM value (see V PWM) divided by the fundamental frequency on variable ac motor speed drives  Accuracy % Vrms + % Hz  Purpose To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages  Accuracy Indicative percentage based on Vac+dc values  Voltage unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages  Accuracy Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages have values  Accuracy Indicative percentage based on V PWM values  Current unbalance drive input  Purpose Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Rise and fall time  Readings Voltage difference (dV), time difference (dV), voltage vs time difference (dV/dV), overshoot As oscilloscope accuracy  Harmonics and spectrum  Harmonics and spectrum  Harmonics DC to 51st  19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Wumber of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1	•	$\pm$ (0.5 % + 2 counts)
Accuracy % Vrms + % Hz  Voltage unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on A ac values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot Accuracy As oscilloscope accuracy  Harmonics DC to 5 ist  Spectrum ranges DC to 9 ist  Spectrum ranges To 9 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Vising 2 GB USB stick or min-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Out mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A		
Voltage unbalance drive input Purpose To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages Accuracy Indicative percentage based on Vac+dc values  Voltage unbalance drive output and motor input Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Indicative percentage based on V PWM values  Current unbalance drive input Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Rise and fall time Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to Sist Spectrum ranges DC to Sist	Purpose	To show the measured V PWM value (see V PWM) divided by the fundamental frequency on variable ac motor speed drives
Purpose To show the highest percentage difference of one of the phase vs average of the 3 true-rms voltages unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to Sist  Spectrum ranges 19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 100:1, 20:1, 20:1, 20:1  Current Clamp 0, 1 mV/A, 1 mV/A, 1 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Accuracy	% Vrms + % Hz
Accuracy Indicative percentage based on Vac+dc values  Voltage unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Accuracy Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Accuracy Indicative percentage based on A ac values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to 51st  Spectrum ranges DC to 51st  Spectrum ranges DL shy, B-J.50 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Roport data capture  Wumber of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 20:1, 20:0:1  Current Clamp 0,1 mV/A, 1 mV/A, 1 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Voltage unbalance drive input	
Voltage unbalance drive output and motor input Purpose To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages Accuracy Indicative percentage based on V PWM values  Current unbalance drive input Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values Accuracy Indicative percentage based on Aac+dc values  Rise and fall time Readings Voltage difference (dV), time difference (dV), voltage vs time difference (dV/dt), overshoot Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to 51st Spectrum ranges DC to 51st Spectrum ranges In 9 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio) Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView** 2 for ScopeMeter**  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1 Current Clamp 0.1 mV/A, 1 m W/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Purpose	
Purpose	Accuracy	Indicative percentage based on Vac+dc values
Accuracy Indicative percentage based on V PWM values  Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on A ac values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to 51st  Spectrum ranges DC to 51st  Spectrum ranges 19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A,		
Current unbalance drive input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on A ac values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to 51st  Spectrum ranges 19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Purpose	To show the highest percentage difference of one of the phase vs average of the 3 PWM voltages
Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on A ac values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot  Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to S1st  Spectrum ranges 19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1.1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Accuracy	Indicative percentage based on V PWM values
Accuracy Indicative percentage based on Aac+dc values  Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on A ac values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics and spectrum  Beyort un ranges DC to 51st  Spectrum ranges 19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Current unbalance drive input	
Current unbalance drive output and motor input  Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on A ac values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot  Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to 51st  Spectrum ranges 19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 1 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A, 400 mV/A	Purpose	
Purpose To show the highest percentage difference of one of the phase vs average of the 3 AC current values  Accuracy Indicative percentage based on A ac values  Rise and fall time  Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot  Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to 51st  Spectrum ranges 19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Accuracy	Indicative percentage based on Aac+dc values
Accuracy  Indicative percentage based on A ac values  Rise and fall time  Readings  Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot  Accuracy  As oscilloscope accuracy  Harmonics and spectrum  Harmonics  DC to 51st  Spectrum ranges  19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second  Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens  Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp  0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A		
Rise and fall time  Readings  Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot  Accuracy  As oscilloscope accuracy  Harmonics and spectrum  Harmonics  DC to 51st  Spectrum ranges  19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second  Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens  Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp  0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Purpose	
Readings Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot  Accuracy As oscilloscope accuracy  Harmonics and spectrum  Harmonics DC to 51st  Spectrum ranges 19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Accuracy	Indicative percentage based on A ac values
Accuracy  Harmonics and spectrum  Harmonics  DC to 51st  Spectrum ranges  19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second  Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens  Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp  0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Rise and fall time	
Harmonics and spectrum  Harmonics DC to 51st  Spectrum ranges 19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Readings	Voltage difference (dV), time difference (dt), voltage vs time difference (dV/dt), overshoot
DC to 51st  Spectrum ranges  19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second  Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens  Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp  O.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Accuracy	As oscilloscope accuracy
Spectrum ranges  19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)  Shaft voltage  Events / second  Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens  Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp  0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Harmonics and spectrum	
Shaft voltage  Events / second Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Harmonics	DC to 51st
Events / second  Indicative percentage based on rise and fall time (Impulse discharges) measurements  Report data capture  Number of screens  Typical 50 screens can be saved in reports (depends on compression ratio)  Transfer to PC  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp  O.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Spectrum ranges	19 kHz, 9-150 kHz (20 MHz filter on), up to 500 MHz (voltage modulation)
Report data capture         Number of screens       Typical 50 screens can be saved in reports (depends on compression ratio)         Transfer to PC       Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™         Probe settings         Voltage Probe       1:1, 10:1, 100:1, 1000:1, 20:1, 200:1         Current Clamp       0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Shaft voltage	
Number of screens  Typical 50 screens can be saved in reports (depends on compression ratio)  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp  7ypical 50 screens can be saved in reports (depends on compression ratio)  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Oltage Probe  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Oltage Probe  0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Events / second	Indicative percentage based on rise and fall time (Impulse discharges) measurements
Transfer to PC  Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™  Probe settings  Voltage Probe  1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp  0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Report data capture	
Probe settings           Voltage Probe         1:1, 10:1, 100:1, 1000:1, 20:1, 200:1           Current Clamp         0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Number of screens	Typical 50 screens can be saved in reports (depends on compression ratio)
Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Transfer to PC	Using 2 GB USB stick or mini-USB to USB cable and FlukeView™ 2 for ScopeMeter™
Voltage Probe 1:1, 10:1, 100:1, 1000:1, 20:1, 200:1  Current Clamp 0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	Probe settings	
Current Clamp 0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A	-	1:1, 10:1, 100:1, 1000:1, 20:1, 200:1
Shaft Voltage Probe 1:1, 10:1, 100:1		0.1 mV/A, 1 mV/A, 10 mV/A, 20 mV/A, 50 mV/A, 100 mV/A, 200 mV/A, 400 mV/A
	Shaft Voltage Probe	1:1, 10:1, 100:1



#### **Ordering information**

Motor drive analyzer, 4 channel, 500 MHz

#### **MDA-550**

Motor drive analyzer, 4 channel, 500 MHz with motor shaft and harmonics

#### Includes

1x BP 291 li-ion battery pack, 1x BC190 charger/power adapter, 3x VPS 100:1 high voltage probes with alligator clips, 1x VPS410-II-R 10:1 500MHz voltage probe, 1x i400s ac current clamp, 1x C1740 carrying case, 1x 2 GB USB drive with manuals and FlukeView™ 2 software

MDA-550 also includes 1x SVS-500 shaft voltage set (3x brush, probe holder, two-piece extension rod and magnetic base), additional 2x i400s ac current clamps

#### **Additional accessories**

**SVS-500** set of 3x brushes, probe holder, two-piece extension rod and magnetic base

**SB-500** set of 3x replacement brushes

\*In addition, Fluke 190 series II ScopeMeter™ Test Tools accessories are also supported by the MDA-500 Series

#### Fluke. Keeping your world up and running.®

#### Fluke Corporation

PO Box 9090, Everett, WA 98206 U.S.A.

#### Fluke Europe B.V.

PO Box 1186, 5602 BD Eindhoven, The Netherlands

#### For more information call:

In the U.S.A. (800) 443-5853 or Fax (425) 446-5116 In Europe/M-East/Africa +31 (0) 40 2675 200 or Fax +31 (0) 40 2675 222 In Canada (800)-36-FLUKE or Fax (905) 890-6866 From other countries +1 (425) 446-5500 or

Fax +1 (425) 446-5116 Web access: http://www.fluke.com

©2018 Fluke Corporation. Specifications subject to change without notice. Printed in U.S.A. 6/2018 6011207b-en

Modification of this document is not permitted without written permission from Fluke Corporation.