CUI DEVICES

MODEL: CMS-35208N | DESCRIPTION: SPEAKER

FEATURES

- 98 dB SPL
- 720 Hz resonant frequency
- Nd-Fe-B magnet



.....



SPECIFICATIONS


parameter	conditions/description	min	typ	max	units
input power	maximum power: IEC-60268-5, filter 60s on/120s off, 10 cycles at room temp		1.0	1.5	W
impedance	at 1.0 kHz, 1.0 V	6.8	8	9.2	Ω
resonant frequency (Fo)	at 1.0 V	576	720	864	Hz
frequency response		Fo		2,500	Hz
sound pressure level	at 1.0 W, 0.1 m ave, at 1.0, 1.2, 1.5, 2.0 kHz	95	98	101	dB
distortion	at 1.0 kHz, 1 W			15	%
buzz, rattle, etc.	must be normal at sine wave between Fo ~ 2,500 Hz		2.83		V
dimensions	35.5 x 20.5 x 8.0				mm
magnet	Nd-Fe-B (Ø11 x 1.5 mm)				
material	ABS UL-94 1/16" HB				
cone material	cloth				
terminal	solder terminals				
weight			5.9		g
operating temperature		-20		60	°C
storage temperature		-20		60	°C
RoHS	yes				
Notes: 1. All specifications measu	red at $5\sim35^{\circ}$ C, humidity at $45\sim85\%$, under $86\sim106$ kPa pressure, unless oth	erwise noted.			

SOLDERABILITY

.....


parameter	conditions/description	min	typ	max	units
hand soldering	for 3 ±1 seconds	360	370	380	°C

MECHANICAL DRAWING

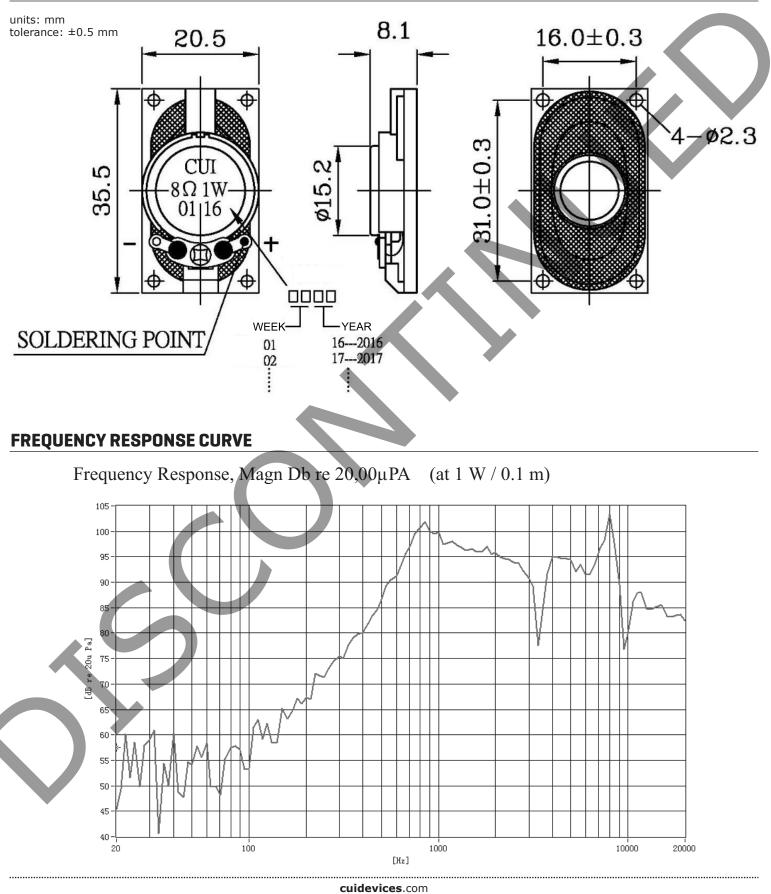

.....

PACKAGING

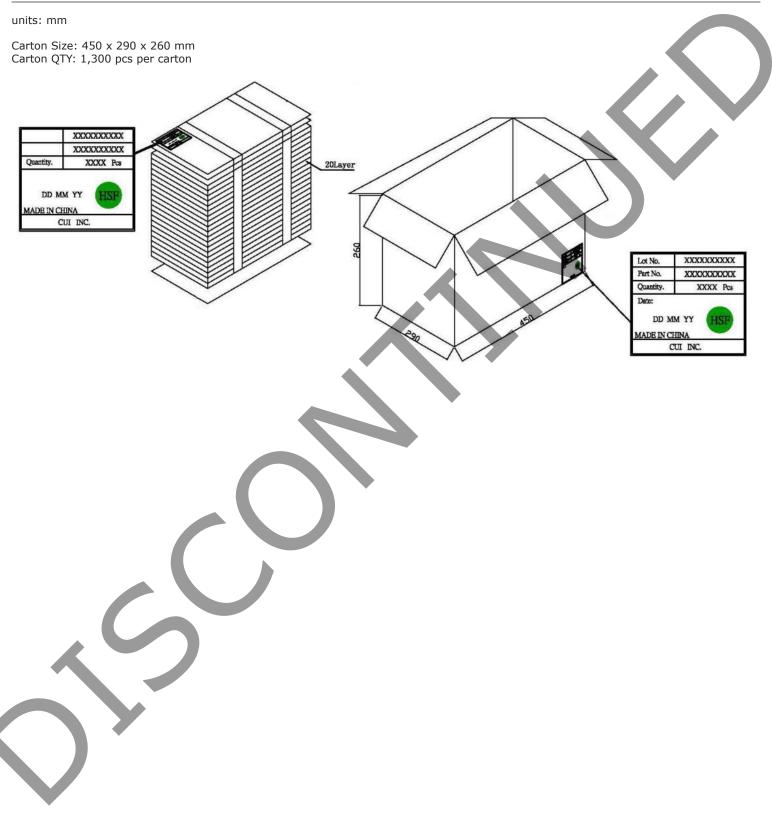

.....

REVISION HISTORY

rev.	description	date	
1.0	initial release	06/21/2016	
1.01	brand update	01/22/2020	

The revision history provided is for informational purposes only and is believed to be accurate



CUI Devices offers a one (1) year limited warranty. Complete warranty information is listed on our website.

CUI Devices reserves the right to make changes to the product at any time without notice. Information provided by CUI Devices is believed to be accurate and reliable. However, no responsibility is assumed by CUI Devices for its use, nor for any infringements of patents or other rights of third parties which may result from its use.

.....

CUI Devices products are not authorized or warranted for use as critical components in equipment that requires an extremely high level of reliability. A critical component is any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.