

LOS/LOR/LOK4000 Series

15, 30, 50 Watt AC-DC & DC-DC DIN-Rail Converters

Convert Simply



The Convert Simply front-end converters represent a family of 15, 30 & 50 watt DIN-rail mountable AC-DC converters for use as rectifiers or battery chargers. Plastic casing, compact size, and high reliability make the LOS, LOR, LOK4000 Series an excellent choice for space-critical applications, where a DIN-Rail mountable AC-DC converter is required. The universal input range and a built-in input filter allow flexible operation in a wide variety of electronic equipment and enables worldwide connection to the mains.

The converters are available as rectifiers with 12 V, 24 V or 48 V single output and special models suitable as battery chargers for 12 V, 24 V, or 48 V batteries. The output voltage of LOK converters can be adjusted via the R input.

Safety approvals fully comply with worldwide requirements.

Applications

Typical applications are: powering building controls, factory automation, industrial controls, instrumentation, electromagnetic drives, fans, and other DC loads.

Note: For new designs, we recommend the LOK Series, which can completely replace LOR and LOS (same connections, same case).

Features

- RoHS lead-free-solder and lead-solder-exempted products are available
- Universal input range 100 – 240 VAC nominal
- Additional DC input 90 – 250 VDC
- Class I equipment
- Single output 5.1, 12, 24, or 48 VDC
- Extremely compact design
- Battery charger versions
- Operating ambient temperature range –10 to 50 °C with convection cooling
- Short-circuit and no-load proof
- Safety-approved to IEC/EN 62368-1 & UL/CSA 60950-1, UL 508 listed components



Table of Contents

Description.....	1	Electromagnetic Compatibility (EMC).....	7
Model Selection.....	2	Immunity to Environmental Conditions.....	8
Functional Description.....	3	Mechanical Data.....	9
Electrical Input Data.....	3	Safety and Installation Instructions.....	10
Electrical Output Data.....	4	Description of Options.....	12
Auxiliary Functions.....	6	Accessories.....	12

Model Selection

Table 1: Standard models

Output		Operating Input Voltage ¹	Rated Power $T_A = 50\text{ }^\circ\text{C}$ $P_{o\text{ tot}}$ [W]	Efficiency η_{typ} [%]	Model	Options ⁴
$V_{o\text{ nom}}$ [VDC]	$I_{o\text{ nom}}$ [A]					
5.1	5.2	85 – 264 VAC 47 – 63 Hz 90 – 250 VDC	26	70	LOK4001-2RLDG	F ² , K, non-G
12	1.25		15	74	LOS4301-2	
12	2.5		30	80	LOR4301-2	
12	4		48	82	LOK4301-2RG	
12 - 12.84 ³ - 15	3.6		49	82	LOK4140-2RLDG	
24	0.65		15	76	LOS4601-2	
24	1.25		30	82	LOR4601-2	
24	2		48	82	LOK4601-2RG	
24 - 25.7 ³ - 30	1.8		49	82	LOK4240-2RLDG	
48	1		48	82	LOK4801-2RG	
48 - 51.4 ³ - 60	0.9	49	81	LOK4740-2RLDG		


¹ Linear derating to 85% of $P_{o\text{ nom}}$ below $V_i = 105\text{ VAC}$, 110 VDC
² LOK types only
³ Setting voltage V_o set for battery chargers with R-input left open-circuit.
⁴ For minimum order quantities and lead times contact the Company.
⁵ Efficiency at V_i rated and $I_{o\text{ nom}}$

Not for new designs (NFND) or End of Life (EOL).

Part Number Description

Series	15 W.....	LOS4
	30 W.....	LOR4
	50 W.....	LOK4
Output	5.1 V rectifier version	001
	12 V rectifier version	301
	24 V rectifier version	601
	48 V rectifier version	801
	12 - 15 V battery charger	140
	24 - 30 V battery charger	240
	48 - 60 V battery charger	740
	other voltages or specs.....	02 - 99
Ambient temperature range T_A	-10 to 50 °C	-2 ³
Features & Options	Output voltage control input ¹	R ²
	Rectangular output characteristic.....	L ¹
	Output voltage OK signal	D ¹
	Built-in second fuse (option)	F ²
	K system connector (option)	K
	RoHS compliant for all six substances	G ⁴

LOK4 301 -2 R L D F K G

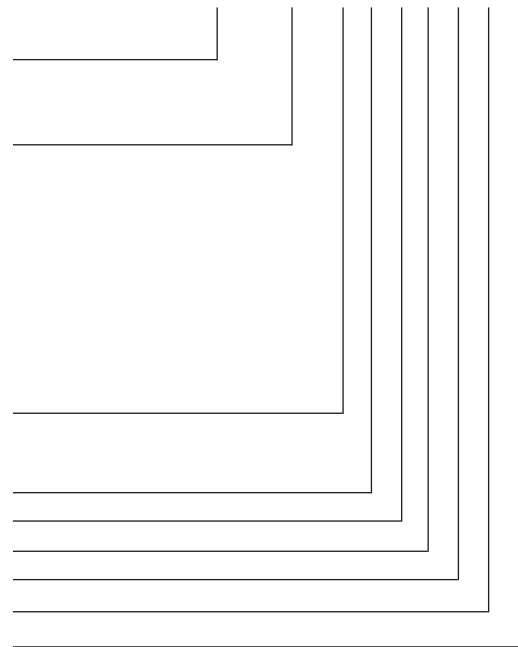

¹ Battery chargers and LOK4001-2RLD
² LOK models only
³ Up to 70 °C with derating
⁴ G is always placed at the end of the part number.

Examples: LOK4140-2RLD: AC-DC converter, battery charger version, providing 12 - 15 V/3.6 A at the output
 LOK4601-2R: AC-DC converter, rectifier version, providing 24 V/2 A, 48 W at the output

Functional Description

The Convert Simply 15, 30, and 50 watt front-end modules are flyback converters with a fixed frequency of 100 kHz (LOK) or 130 kHz (LOR, LOS). The battery charger modules and the LOK4001-2RLD have a rectangular V/I output characteristic. The rectifier modules have overload protection working in a hiccup mode.

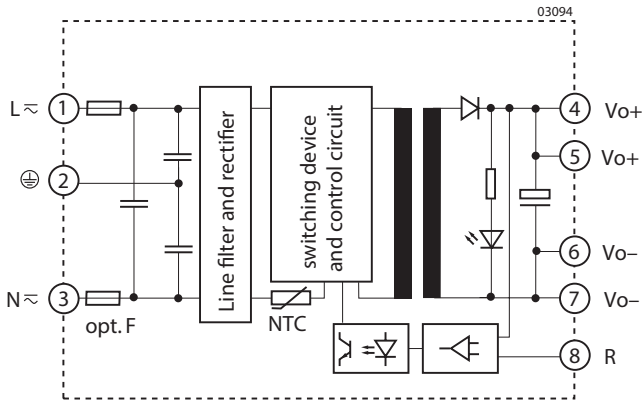


Fig. 1
Block diagram LOK4301, LOK4601 and 4801
(rectifier versions), all LOR and all LOS.

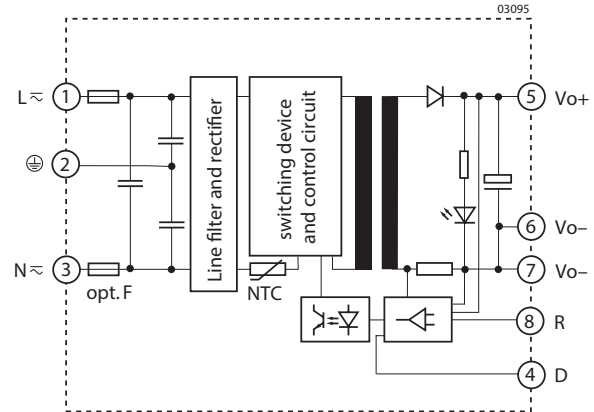


Fig. 2
Block diagram LOK4140, LOK4240 and LOK4740
(battery charger versions) and LOK4001- 2RLD.

Electrical Input Data

General conditions: $T_A = 25\text{ }^\circ\text{C}$, unless otherwise specified.

Table 2: Input data

Input Characteristics		LOS	LOR	LOK	Unit
$V_{i\text{ rated}}$	Rated input voltage range	100 - 240	100 - 240	100 - 240	VAC
$V_{i\text{ nom}}$	Nominal input voltage	230	230	230	
V_i	Operating input voltage range	85 - 264	85 - 264	85 - 264	VDC
		90 - 250	90 - 250	90 - 250	
f_i	Nominal line frequency	50 - 60	50 - 60	50 - 60	Hz
I_i	Input current at 115 / 230 VAC ¹	0.3/0.15	0.52/0.26	0.8/0.4	A
$I_{i\text{ nl}}$	Input current at 230 VAC and no load			0.035	
$I_{i\text{ nr max}}$	Peak inrush current at $V_i = 230\text{ V}^2$	18	18	19	

¹ At $I_{i\text{ nom}}$.

² Inrush current limitation by a 16 Ω NTC resistor.

Electrical Output Data

General conditions: $T_A = 25\text{ }^\circ\text{C}$, unless otherwise specified. R input not connected.

Table 3a: Output data

Model		LOK4001-2RLD			LOS/LOR/LOK 4301-2(R)			LOS/LOR/LOK 4601-2(R)			LLOK4801-2R			Unit		
Characteristics		Conditions		min	typ	max	min	typ	max	min	typ	max	min	typ	max	
$V_{o\text{ nom}}$	Output voltage $V_{o\text{ nom}}$	$V_{i\text{ nom}}, 0.5 I_{o\text{ nom}}$		5.1			12			24			48			V
	V_o setting tolerance	R-input open-circuit		± 1.5			± 1.5			± 1.5			± 1.5			%
$V_{o\text{ adj}}$	Adjustable voltage range	Units with feature R		4.5 - 5.5			10.8 - 13.2			21.6 - 26.4			43.2 - 52.8			V
$I_{o\text{ nom}}$	Nominal output current	$V_{i\text{ min}} - V_{i\text{ max}}$	LOS LOR LOK	-			1.25 2.5 4.0			0.65 1.25 2.0			- - 1.0			A
V_o	Output voltage noise (BW = 20 MHz)	$V_{i\text{ nom}}, I_{o\text{ nom}}$ IEC 61200		50			100 50			100 50			200			mV _{pp}
	Static line/ load regulation	$V_{i\text{ min}} - V_{i\text{ max}}$ $I_o = (0.1 - 1) I_{o\text{ nom}}$		± 1			± 1			± 1			± 1			%
$V_{o\text{ l}}$	Dynamic load regulation	$V_{i\text{ nom}}, (0.1 \times 0.9) I_{o\text{ nom}}$		± 5			± 2			± 1.5			± 1			
t_r	Transient recovery time	$I_o = (0.1 \times 0.9) I_{o\text{ nom}}$		4			4			4			4			ms
t_h	Hold-up time	115/230 VAC		14/90			14/90			14/90			14/90			
α_{V_o}	Temperature coefficient of V_o	$V_{i\text{ nom}}, I_{o\text{ nom}}$		± 0.5			± 0.5			± 0.5			± 0.5			%/K
f_s	Switching frequency			100			100 ¹			100 ¹			100 ¹			kHz

¹ LOR and LOS have 130 kHz.

Table 3b: Output data (battery charger models)

Model		LOK4140-2RLD			LOK4240-2RLD			LOK4740-2RLD			Unit		
Characteristics		Conditions		min	typ	max	min	typ	max	min	typ	max	
$V_{o\text{ nom}}$	Output voltage $V_{o\text{ nom}}$	$V_{i\text{ nom}}, 0.5 I_{o\text{ nom}}$ R-input open-circuit		12.84 ¹			25.68 ¹			51.36 ¹			V
$V_{o\text{ adj}}$	Adjustable voltage range			12 - 15			24 - 30			48 - 60			V
$I_{o\text{ nom}}$	Nominal output current	$V_{i\text{ min}} - V_{i\text{ max}}$		3.6			1.8			0.9			A
V_o	Output voltage noise (BW = 20 MHz)	$V_{i\text{ nom}}, I_{o\text{ nom}}$ IEC 61204		100 50			100 50			200			mV _{pp}
	Static line/ load regulation	$V_{i\text{ min}} - V_{i\text{ max}}$ $I_o = (0.1 - 1) I_{o\text{ nom}}$		± 2 ¹			± 1 ¹			± 1 ¹			%
$V_{o\text{ l}}$	Dynamic load regulation	$V_{i\text{ nom}}, (0.1 \times 0.9) I_{o\text{ nom}}$		± 2 ¹			± 1.5 ¹			± 1 ¹			
t_r	Transient recovery time	$I_o = (0.1 \times 0.9) I_{o\text{ nom}}$		4			4			4			ms
t_h	Hold-up time	115/230 VAC		14/90			14/90			14/90			
α_{V_o}	Temperature coefficient of V_o	$V_{i\text{ nom}}, I_{o\text{ nom}}$		± 0.5 ¹			± 0.5 ¹			± 0.5 ¹			%/K
f_s	Switching frequency			100			100 ¹			100 ¹			kHz

¹ R input left open-circuit.

Thermal Considerations

If an AC-DC converter is located in free, quasi-stationary air (convection cooling) at the indicated maximum ambient temperature $T_{A \max}$ (see table: *Temperature specifications*) and is operated at its nominal input voltage and output power, the temperature measured at the *Measuring point of case temperature* T_C (see *Mechanical Data*) will approach the indicated value $T_{C \max}$ after the warm-up phase. However, the relationship between T_A and T_C depends heavily on the conditions of operation and integration into a system. The thermal conditions are influenced by input voltage, output current, airflow, temperature of surrounding components and surfaces. $T_{A \max}$ is therefore, contrary to $T_{C \max}$, an indicative value only.

The relation between the maximum allowed output power $P_{o \text{ allowed}}$ and the temperature T_A of the surrounding air is given in the Fig.3 below. The rates apply if the AC-DC converter is located in free, quasi-stationary air (convection cooling).

Note: Sufficient forced cooling allows T_A to be higher than the value given in the table if $T_{C \max}$ according to the table is not exceeded.

Caution: The installer must ensure that under all operating conditions T_C remains within the limits that are stated in the table *Temperature specifications*.

Output Power at Low Input Voltage

The output power of LOK models must be derated at low input voltage, see Fig. 4 below.

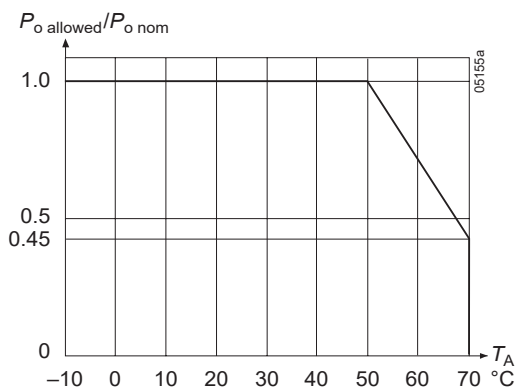


Fig. 3
Maximum allowed output power versus ambient temperature at $V_i > 105$ VAC for LOK models, operated in vertical position

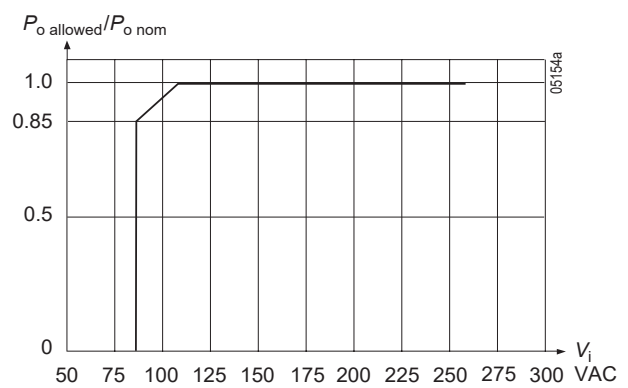


Fig. 4
Maximum allowed output power versus input voltage at $T_A = 50$ °C for LOK models operated in vertical position

Output Protection

Battery charger versions LOK4140-, 4240-, LOK4740-2RLD, and the LOK4001-2RLD have a rectangular current limitation characteristic, which limits the output current to within 100 and 150% of $I_{o \text{ nom}}$. The other models are protected against overload by a current limiting circuit, which shuts down the converter in overload condition. It automatically restarts after removal of the overload condition (hiccup mode).

All models are short-circuit and no-load proof.

Outputs Connected in Series

Two or more converters supplying the same or different output voltages may be connected in series. The value of the maximum output current to be taken is defined by that unit providing the lowest current limiting value. It should be assured that the outputs do not feed backwards into each other caused by their different rise/fall times at switch-on/off cycles by adding reverse polarity diodes across each output.

Parallel Operation

Only possible with battery charger versions.

The outputs of several battery charger models with equal output voltage (e.g. several LOK4240-2RLD) may be connected in parallel.

Auxiliary Functions

Adjustable Output Voltage (R input)

As a standard feature, the LOK units offer adjustable output voltage by using the control input R. If the R pin is left open-circuit, the output voltage is set to $V_{o\ nom}$. (see: *Output data*)

The R input is referenced to the secondary side of the converter. Adjustment of the output voltage is possible by means of either an external resistor or a voltage source.

a) Adjustment by means of an external resistor R_{ext1} :

Depending upon the value of the required output voltage, the resistor shall be connected

either: Between the R terminal and Vo- to achieve an output voltage adjustment range of approximately $V_o = 90$ to $100\% V_{o\ nom}$ (LOK4301, 4601, and 4801 types).

$$R_{ext1} \approx 4\text{ k}\Omega \cdot \frac{V_o}{V_{o\ nom} - V_o}$$

or: Between the R terminal and Vo+ to achieve an output voltage range of approximately $V_o = 100$ to 110% of $V_{o\ nom}$ for rectifier versions and 100 to 125% of $V_{o\ nom}$ for battery chargers.

$$R_{ext2} \approx 4\text{ k}\Omega \cdot \frac{(V_o - 2.5\text{ V})}{2.5\text{ V} \cdot (V_o/V_{o\ nom} - 1)}$$

b) Adjustment by means of an external voltage V_{ext} between Vo- and R terminal to achieve an output voltage adjustment range of approx. 90 to 110% of $V_{o\ nom}$ (LOK 4301, 4601 and 4801 types), 93 to 117% of $V_{o\ nom}$ for battery chargers.

$$V_{ext} \approx \frac{V_o \cdot 2.5\text{ V}}{V_{o\ nom}}$$

Attempting to adjust the output below this range will cause the converter to shut down (hiccup mode).

Note: Applying an external control voltage $>3\text{ V}$ may damage the converter.

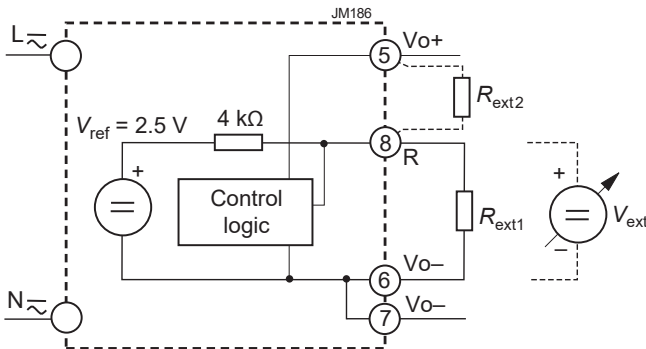


Fig. 5
Output voltage control by means of the R-input

Output Voltage OK (D Output)

The D-output is referenced to Vo- and monitors the output voltage V_o . If V_o drops below $V_{o\ t}$, the D-output will be disabled (open-collector circuit). The circuitry works independently of the input voltage and can therefore be used as battery-low indicator.

Table 4: Output Voltage OK signal

Conditions		LOK4001-2RLD		LOK4140-2RLD		LOK4240-2RLD		LOK4740-2RLD		Unit
		min	max	min	max	min	max	min	max	
$V_{o\ t}$	setting	4.4	4.8	10.5	11.5	21	23	42	46	V
V_D	$V_o - V_{o\ t\ min}$	60		60		60		60		
	$V_o > V_{o\ t\ max}$	0.6		0.6		0.6		0.6		
$I_D < 50\text{ mA}$										

Battery Charging/Temperature Sensor

The LOK 4140/4240/4740 are designed to charge lead-acid batteries. For optimum battery charging and extended life time of the battery an external temperature sensor may be connected to the R-input. The sensor should be mounted as close as possible to one of the poles of the battery.

Depending upon the cell voltage and the temperature coefficient of the battery, different temperature sensors are available. For more information please see: *Temperature Sensors* (Accessory Products on our web site).

If no sensor is used, the float charge voltage should be adjusted with a suitable resistor connected to the R input (see: *Adjustable Output Voltage*).

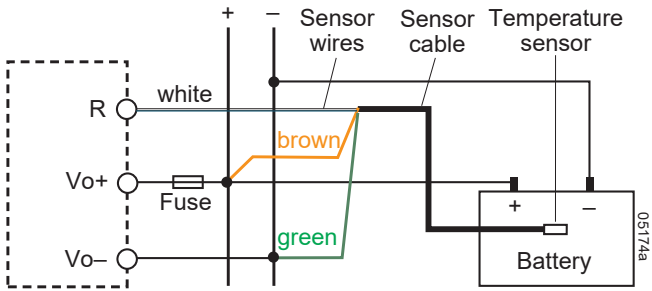


Fig. 6
Voltage setting by a temperature sensor, wiring diagram

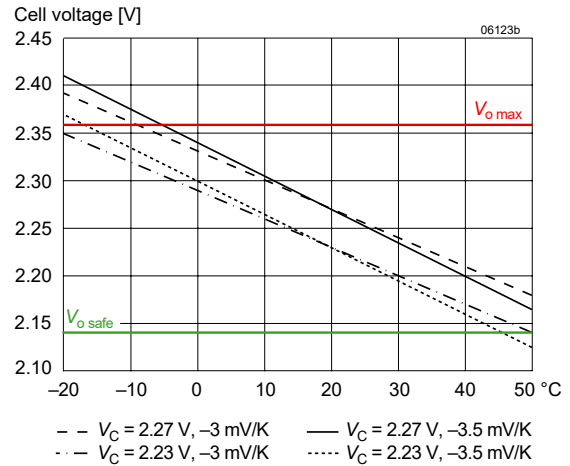


Fig. 7
Float charge voltage for defined temperature coefficients.

Electromagnetic Compatibility (EMC)

Immunity

A metal-oxide VDR together with the input fuse and the input filter form an effective protection against high input transient voltages, which typically occur in most installations. The LOS, LOR and LOK series have been successfully tested to the following specifications:

Table 5: Electromagnetic immunity (type tests)

Phenomenon	Standard ¹	Level	Coupling mode ²	Value applied	Waveform	Source imped.	Test procedure	In oper.	Perf. crit. ³
Electrostatic discharge	IEC/EN 61000-4-2	3	contact discharge	$\pm 4000 V_p$	1/50 ns	330 Ω	10 positive and 10 negative discharges	yes	A
			air discharge	$\pm 8000 V_p$					
Electromagnetic field	IEC/EN 61000-4-3	2	antenna	3 V/m	AM 80%, 1 kHz	N/A	80 – 1000 MHz 900 MHz 1800 MHz	yes	B
Electrical fast transients/burst	IEC/EN 61000-4-4	3	direct i/⊕, +i/-i	2000 V_p	bursts of 5/50 ns 2.5/5 kHz over 15 ms; burst period: 300 ms	50 Ω	60 s positive 60 s negative transients per coupling mode	yes	B
Surges	IEC/EN 61000-4-5	3	i/⊕	2000 V_p	1.2 / 50 μs	12 Ω	5 pos. & 5 neg. surges per coupling mode	yes	A
		2	+i/-i	1000 V_p		2 Ω			
Conducted disturbances	IEC/EN 61000-4-6	2	box	3 VAC	AM 80%, 1 kHz	150 Ω	0.15 – 80 MHz	yes	A

¹ Related and previous standards are referenced in: Technical Information: Standards

² i = input, o = output, ⊕ = PE case.

³ A = Normal operation, no deviation from specifications, B = Normal operation, temporary deviation from specs possible.

Emissions

Internal input filtering keeps the conducted noise of the converters within the frequency range of 150 kHz to 30 MHz below the limits of the standard EN 55032.

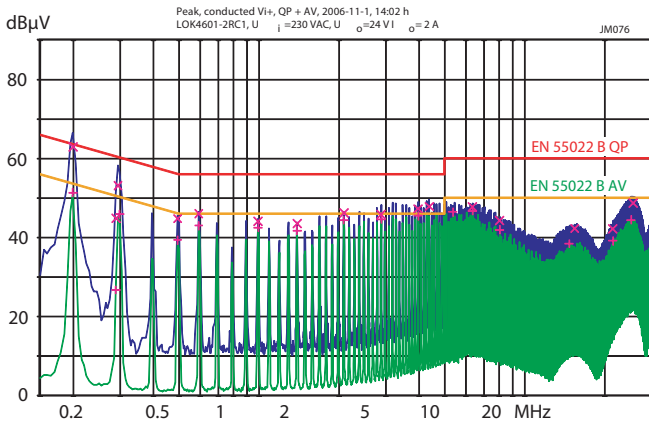


Fig. 8 Typical conducted disturbances (quasi-peak, average) at the input accord. to EN 55032 at $V_{i,nom}$ and $I_{o,nom}$ (LOK4601-2R)

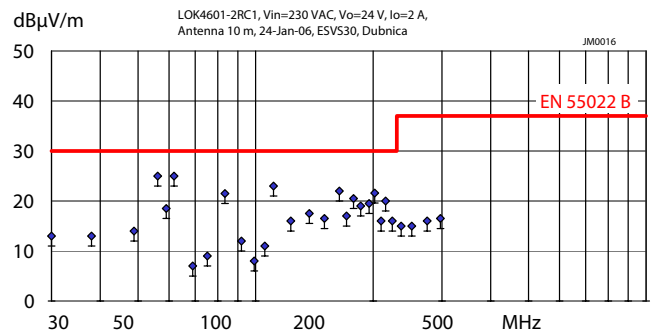


Fig. 9 Radiated disturbances measured according to EN 55011/55032 at $V_{i,nom}$ and $I_{o,nom}$. LOK4601-2R, $V_i = 230$ VAC.

Immunity to Environmental Conditions

Table 6: Mechanical stress

Test method		Standard	Test Conditions	Status
Cab	Damp heat steady state	IEC/EN 60068-2-78 MIL-STD-810D section 507.2	Temperature: 40 ±2 °C	Converter not operating
			Relative humidity: 93 ±2/-3 %	
			Duration: 21 days	
Ea	Shock (half-sinusoidal)	IEC/EN 60068-2-27 MIL-STD-810D sect. 516.3	Acceleration amplitude: 15 g _n = 147 m/s ²	Converter operating
			Bump duration: 11 ms	
			Number of bumps: 18 (3 in each direction)	
Eb	Bump (half-sinusoidal)	IEC/EN 60068-2-29 MIL-STD-810D sect. 516.3	Acceleration amplitude: 10 g _n = 98 m/s ²	Converter operating
			Bump duration: 11 ms	
			6000 bumps: 6000 (1000 in each direction)	
Fc	Vibration (sinusoidal)	IEC/EN 60068-2-6 MIL-STD-810D sect. 514.3	Acceleration amplitude: 0.15 mm (10 – 60 Hz)	Converter operating
			2 g _n = 20 m/s ² (60 – 150 Hz)	
			Frequency (1 Oct/min): 10 – 150 Hz	
			Test duration: 3.75 h (1.25 h each axis)	

Temperatures

Table 7: Temperature specifications

Model		Conditions	LW models -6		Unit
Characteristics			min	max	
T _A	Ambient temperature	Converter operating ¹	-10	50	°C
T _C	Case temperature		-10	80	
T _S	Storage temperature	Non operational	-40	85	

¹ See Thermal Considerations

Failure Rates

Table 8: MTBF values

MTBF	Module type	Ground benign $T_c = 40\text{ °C}$	Ground fixed		Ground mobile $T_c = 50\text{ °C}$	Unit
			$T_c = 40\text{ °C}$	$T_c = 70\text{ °C}$		
According to MIL-HDBK-217F, Notice 2	LOK	1 600 000	400 000	200 000	120 000	h

Mechanical Data

Dimensions in mm.

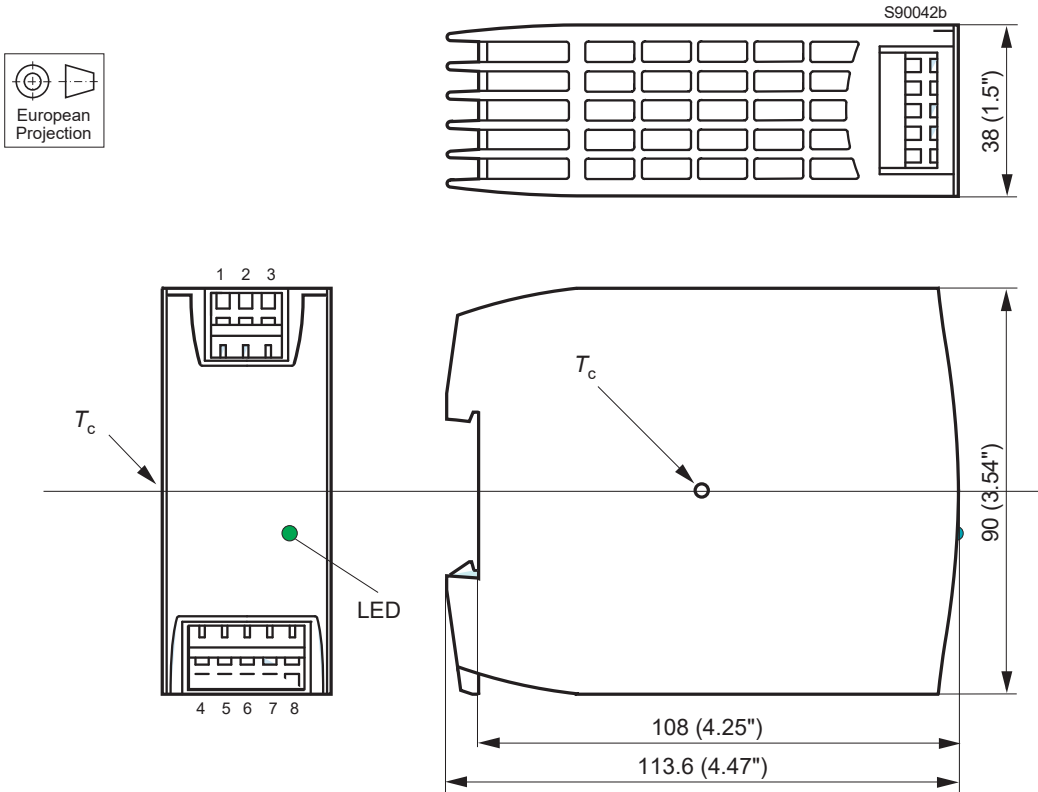


Fig. 10

Case

LOK weight: approx. 0.35 kg, LOS/LOR weight: approx. 0.25 kg

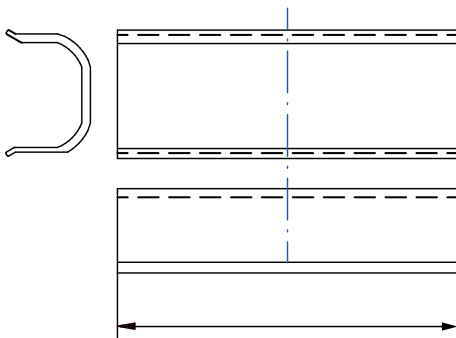


Fig. 11

Cover to protect both connectors; see Accessories. Material Lexan 2014R

Safety and Installation Instructions

Terminal Allocation

The terminal allocation table defines the electrical potentials of the AC-DC converters. For mechanical positions of the terminals see *Mechanical Data*.

Table 9: Terminal allocation

Pin no.	Electrical	LOK/LOR/LOS
1	Input (fused)	L≈
2	Protective earth PE	⊕
3	Input	N≈
4	D / Output (positive)	D / +
5	Output (positive)	+
6	Output (negative)	-
7	Output (negative)	-
8	R input or open	R/ n.c.

Standards and Approvals

LOK models are safety-approved according to the standards IEC/EN 62368-1 and UL/CSA 60950-1.

LOS/LOR models are safety-approved according to the standards IEC 60950-1 and UL/CSA 60950-1.

All models are UL 508-listed.

These converters have been evaluated for:

- Class I equipment.
- Building in with vertical mounting on a DIN-rail.
- Double or reinforced insulation or an earthed part between input and output.
- Basic insulation between input and earth
- Functional insulation between output and earth
- Pollution degree 2 environment
- Connecting the input to a primary circuit with overvoltage category II.

The converters are subject to manufacturing surveillance in accordance with the above mentioned standards.

For details see the Declaration of Conformity (last 2 pages).

Cleaning Liquids and Protection Degree

In order to avoid possible damage, any penetration of liquids shall be avoided. The converters correspond to protection degree IP 20 (all models).

Installation Instructions

These converters are components, intended exclusively for inclusion within other equipment by an industrial assembly operation or by professional installers. Installation must strictly follow the national safety regulations in compliance with the enclosure, mounting, creepage, clearance, casualty, markings and segregation requirements of the end-use application.

Connection to the system shall be according to *Terminal allocation* and *Mechanical Data*. Check for hazardous voltages before altering any connection.

Ensure that a converter failure (e.g. by an internal short-circuit) does not result in a hazardous condition. See also *Safety of operator accessible output circuit*.

The phase input (L≈) is internally fused by a 1.6 A slow blow type. It is not customer-accessible. This fuse is designed to protect the unit in case of overcurrent. Option F or external fuses in the wiring to one or both input lines (L≈ and/or N≈) may therefore be necessary to ensure compliance with local requirements.

A second fuse in the wiring to the terminal N= is needed if:

- Local requirements demand an individual fuse in each source line
- Neutral and earth impedance is high or undefined
- Phase and neutral of the mains are not defined or cannot be assigned to the corresponding terminals (L= to phase and N= to neutral).

Note: Do not open the converters, or guarantee will be invalidated.

Make sure that there is sufficient air flow available for convection cooling. This should be verified by measuring the case temperature when the unit is installed and operated in the end-use application. The maximum specified case temperature $T_{C_{max}}$ shall not be exceeded.

Note: The converters are designed for vertical mounting on a DIN-rail. If a converter is operated as well in a horizontal position, the measuring point T_C should be located on the top.

Isolation

The electric strength test is performed in the factory as routine test according to EN 62911 and IEC/EN 62368-1. The Company will not honor warranty claims resulting from incorrectly executed electric strength field tests.

Table 10: Isolation

Characteristics		Input to Protective Earth	Input to Output	Output to Protective Earth	Unit
Electric strength test	Factory test ≥ 1 s	2.1	2.1 ¹	1.4	kVDC
	AC test voltage equivalent to factory test	1.5	1.5 ¹	1.0	kVAC
Insulation resistance at 500 VDC		>300	>300	>100	M Ω

¹ Subassemblies are pre-tested with 4.3 kVDC or 3.0 kVAC.

Touch Current

Touch current flow due to internal leakage capacitances and Y-capacitors. The current values are proportional to the supply voltage and are specified in the table below..

Table 11: Touch currents

Characteristics		LOK	Unit
Maximum touch current	Permissible according to IEC/EN 62368-1	5.0	mA
	Typical value at 264 V, 60 Hz	1.0	

Safety of Operator-Accessible Output Circuits

The output circuit of the converter is an ES1 circuit according to the IEC/EN 62368-1 related safety standards.

The following table shows a possible installation configuration, compliance with which causes the output circuit of an LOS, LOR or LOK4000 converter to be an ES1 circuit up to a configured output voltage.

However, it is the sole responsibility of the installer to assure compliance with the applicable safety regulations.

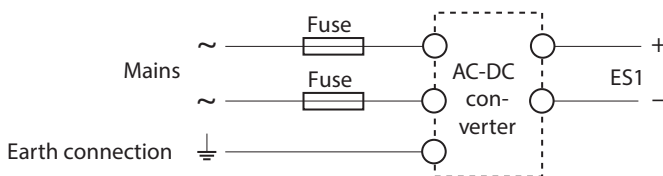


Fig. 12
Schematic safety concept

Table 12: Safety concept leading to a ES1 output circuit

Conditions	AC-DC converter	Installation	Result
Nominal supply voltage	Grade of insulation between input and output, provided by the AC-DC converter	Measures to achieve the resulting safety status of the output circuit	Safety status of the AC-DC converter output circuit
Mains ≤ 250 VAC	Double or reinforced	Earth connection ¹ and installation according to the applicable standards	ES1 circuit

¹ The earth connection of terminal no. 2 has to be provided by the installer according to the relevant safety standards, e.g. IEC/EN 62368-1.

Description of Options

F: Built-in Second Fuse

A built-in second fuse in the neutral input line enables safe connection to the mains where phase and neutral are not defined or cannot be identified as e.g., in the case of plug and socket connection to the mains via Schuko-plugs; see also *Installation Instruction*.

K: System Connectors

For installation into systems using preassembled harnesses the converters are available with connectors fitted with screw terminals. The system connectors are UL-listed and approved for currents up to 10 A. Wire cross-sections: Solid wires 1.5 mm² (AWG 14), stranded wires 1 mm² (AWG 16).

G: RoHS

RoHS-compliant for all six substances.

Accessories

Protective covers are available to avoid touching of the terminals; see fig. 11, *Mechanical Data*.

HZZ01221-G contains in a bag a plastic covers with length

A = 18 mm for the primary terminals and a second one with length A = 26.5 mm for the secondary connector.

NUCLEAR AND MEDICAL APPLICATIONS - These products are not designed or intended for use as critical components in life support systems, equipment used in hazardous environments, or nuclear control systems.

TECHNICAL REVISIONS - The appearance of products, including safety agency certifications pictured on labels, may change depending on the date manufactured. Specifications are subject to change without notice.