OUTLINE REF.	MOUNTING** TYPE	FIG.	DIMENSIONS IN INCHES (mm in parentheses)									
			A	B	C	D	E	F	G	H	J	K
LA70P900 TO 1000	4	1	7.59 (193)	3.50 (88.9)	3.84 (97.5)	6.97 (152)	5.22 (133)	0.63 (16.0)	2.75 (69.9)	0.50 (12.7)	0.63 (15.9)	-
LA70P1200	4	2	10.84 (275.4)	4.50 (114.3)	3.84 (97.5)	6.84 (173.7)	5.84 (148.3)	9.34 (237.3)	9.59 (243.8)	3.50 (88.9)	.63 (15.9)	.75 (19.1)

**MOUNTING TYPE: 4 - BOLT-IN BLADE

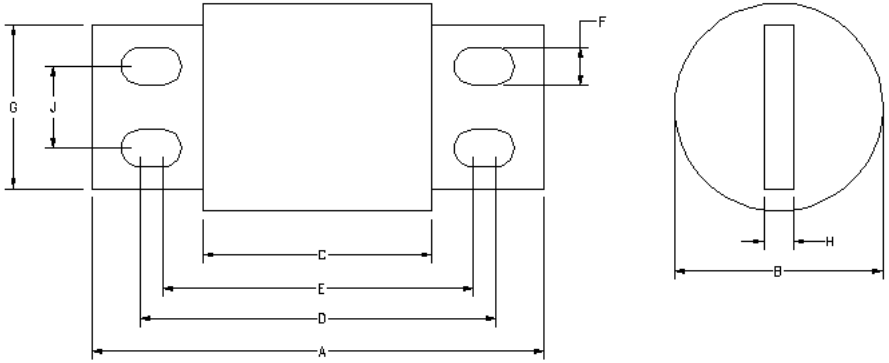

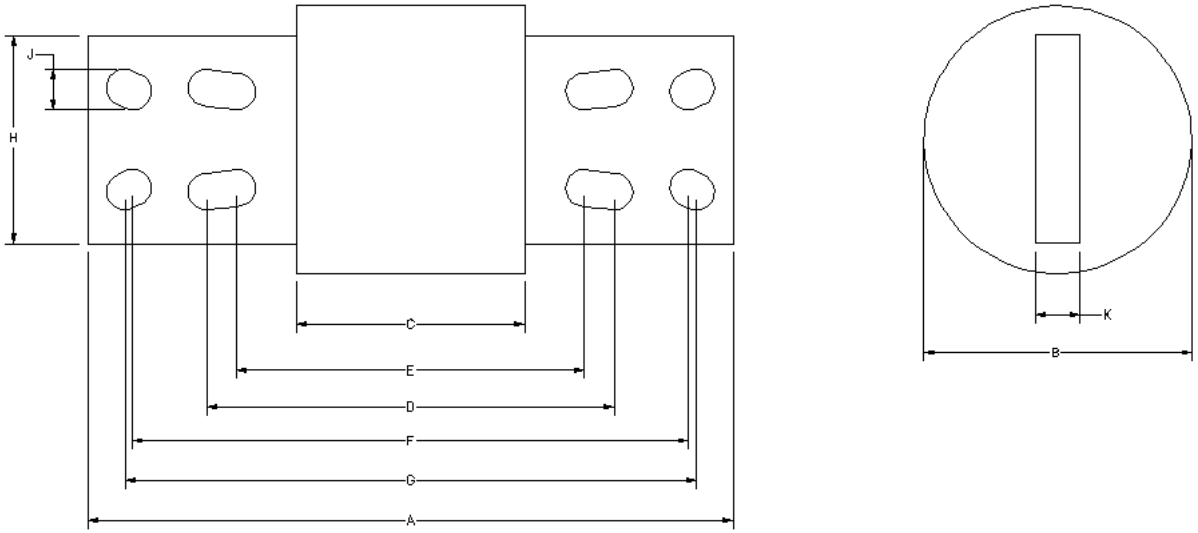

PART NUMBER	AMPERE RATING	UPC CODE
LA70P9004	900	079458 15158
LA70P10004	1000	079458 15159
LA70P12004	1200	079458 15160

LTR	DATE	REVISION	CHK	APD
A	04/03/03	61043-RELEASED NRD	TN	ND

RATINGS

AC: 35-800A 700VAC, 200kA I.R.

DC: 35-800A 700VDC, 100kA I.R.
L/R = 10ms

NO	COMPONENT NO	DESCRIPTION	QTY/M	U/M

BILL OF MATERIAL

UNLESS OTHERWISE SPECIFIED, DIMENSIONS DO NOT INCLUDE PLATING.

●	DENOTES CRITICAL CHARACTERISTICS.
CPK	DENOTES CPK DIMENSIONS,-MINIMUM CPK VALUE
⟨ST⟩	DENOTES A CHARACTERISTIC THAT PROVIDES AN INDICATION OF PROCESS PERFORMANCE. PROCEDURE FOR MEASUREMENT AND TRACKING TO BE DEFINED IN LITTELFUSE INSPECTION INSTRUCTIONS.
CP	DENOTES CP DIMENSIONS,-MINIMUM CP VALUE MUST BE WITHIN THE DIMENSIONAL LIMITATIONS SHOWN ON DRAWING AND INITIALLY LOCATED TO ALLOW FOR MAXIMUM TOOL LIFE.

C

COPIES TO

1	9	18
2	10	19
3	12	20
4	13	21
5	14	23
6	15	33
7	16	43
8	17	53

MATL SPEC

FINISH

DRN NRD	DATE 04/03/03	SCALE 1:1.5	
CHK TN	DATE 04/03/03	SUPER DR	
APPD ND	DATE 04/03/03	RAW STK WT LBS/M	

TOLERANCE UNLESS OTHERWISE SPECIFIED
TWO PLACE DEC ±.01 FRACTION ±
THREE PLACE DEC ±.005 ANGULAR ±1°

TITLE

LA70P 900 THRU 1200A

Littelfuse® DES PLAINES, ILLINOIS 60018

REVISION A

DRAWING NO. LA70P000

FINAL

CAD GENERATED DRAWING - NO PENCIL CHANGES ALLOWED