SAFETY ORGANIZATIONS

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET:

UL RECOGNIZED: UL 1283 CSA CERTIFIED: CSA C22.2 No. 8 VDE APPROVED: EN 60939-2

OPERATING SPECIFICATIONS

LINE CURRENT/VOLTAGE: 3 AMP/40°C, 120/250 VAC

LINE FREQUENCY:

50-60Hz

MAXIMUM LEAKAGE CURRENT, EACH LINE TO GROUND:

2.0µA @ 120V 60Hz

5.0µА @ 250V 50Hz

OPERATING AMBIENT TEMP. RANGE: -10°C TO +40°C @ RATED CURRENT, Ir.

IN AN AMBIENT, T_Q, HIGHER THAN 40°C, THE MAXIMUM OPERATING CURRENT, I_Q, IS AS FOLLOWS: $I_{-} = I_{-} - \sqrt{100 - I_{\rm P}}$

<u> 100 - To</u> $I_0 = I_r$

<u>RELIABILITY SPECIFICATIONS:</u>

STORAGE TEMPERATURE: -40°C TO +85°C HUMIDITY: 21 DAYS € 40°C 95% RH. CURRENT OVERLOAD TEST: 6 TIMES I_C FOR 8 SECONDS

CUSTOMER DRAWING CATALOG # 3EHG1-2 APPRVD DATE

KAW

TEST SPECIFICATIONS:

INDUCTANCE; 1.99 mH NOMINAL

CAPACITANCE: (MEASURED @ 1KHz, 0.250VAC MAX., 25°C±1°C)

LINE TO GROUND:

N/A μF±20% 0.10 μF±20%

LINE TO LINE:

DISCHARGE RESISTOR: 1.5 MA

L/G AND L/L I.R. NO DISCHARGE RESISTOR:

6000M₁ (MIN.) @ 100VDC,

20°C AND 50% RH


RECOMMENDED RECEIVING INSPECTION HIPOT:

LINE TO GROUND: 1500 VAC OR 2250 VDC FOR 1 MINUTE

1450 VDC FOR I MINUTE LINE TO LINE:

FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

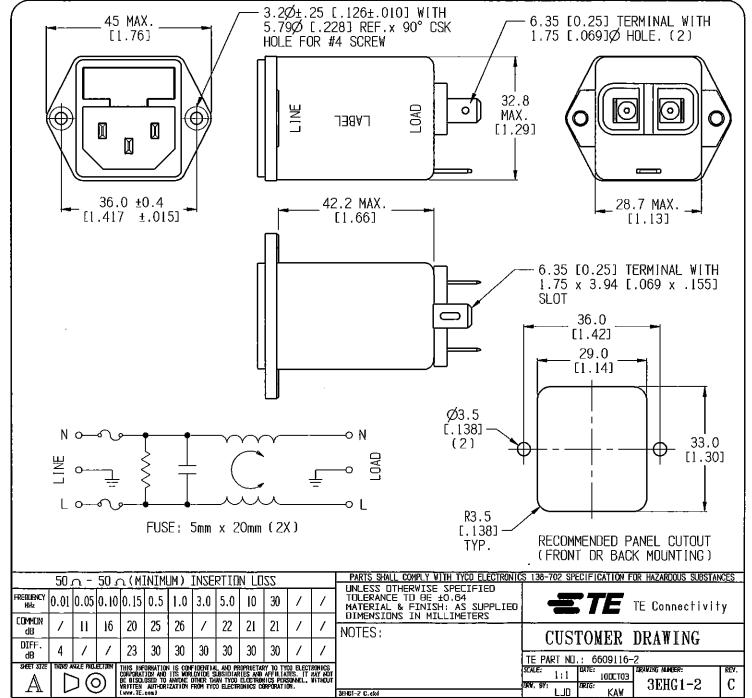

3EHC1-2 C.ekd