


# RT250 GFCI RECEPTACLE TESTER WITH LCD

For use with North American  
3-wire 120V Electrical Outlets

Easy-to-read LCD  
display shows

- Voltage
- Wiring-faults
- GFCI Trip Time

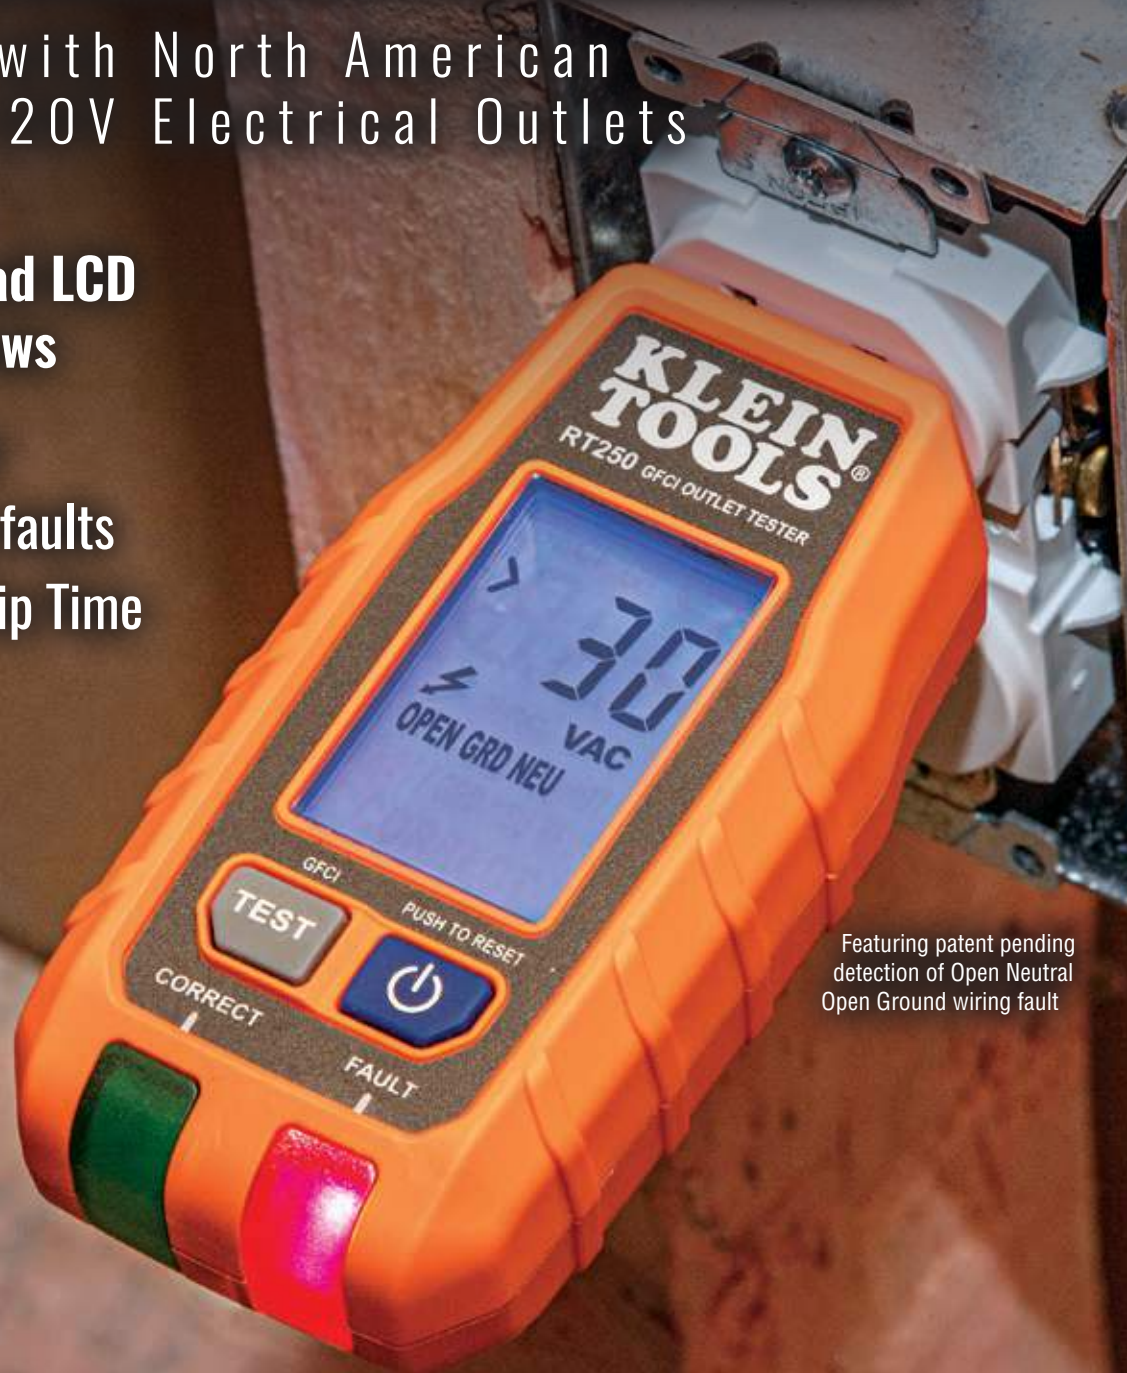

Featuring patent pending  
detection of Open Neutral  
Open Ground wiring fault



CAT II  
135V

**KLEIN  
TOOLS**





# RT250 GFCI RECEPTACLE TESTER WITH LCD

The RT250 is an electrical receptacle tester that tests the wiring conditions at an electrical outlet and inspects GFCI devices. The LCD displays the voltage, identifies the wiring fault, and the time required to trip a GFCI device. It is designated for use with North American 3-wire 120V electrical outlets.

Test trip time of ground fault circuit interrupter

For use on 3-wire, North American 120V electrical outlets only

Auto-Hold is convenient for hard-to-reach outlets. Simply remove tester to view the reading.

Large readout clearly displays voltage and GFCI trip time

Large backlit LCD display shows clear indication of wiring conditions

GFCI button initiates a ground fault. The voltage and trip time readings alternate in the display.

Bright green and red LEDs illuminate for visual indicators

Low battery indicator. Tester comes with 2x AAA batteries; compartment is on back.

Power button; tester auto-powers off after 3 minutes of inactivity to conserve battery life.

## WIRING CONDITIONS

- Wired Correctly
- Open Ground
- Open Neutral
- Open Hot
- Dual Open (Neutral & Ground)  
Patent Pending
- Reversed Hot/Ground
- Reversed Hot/Neutral

## CLEAR INDICATION OF VOLTAGE AND WIRING CONDITIONS



For Professionals  
**SINCE 1857™**

Cat. No.	UPC	Description	Batteries Included	Height	Length	Width	Weight
RT250	69321-2	GFCI Receptacle Tester with LCD	2x AAA	1.1" (2.79 cm)	4.5" (11.4 cm)	2.0" (5.1 cm)	4.8 oz (136 g)

Warning statement: Visit [www.kleintools.com](http://www.kleintools.com) for safety warnings.



See our complete line of Test & Measurement Products  
[www.kleintools.com](http://www.kleintools.com)



© 2020 Klein Tools, Inc.  
Lincolnshire, IL 60069  
82920 Rev. 04/20 A