
Anybus Communicator - DeviceNet Interface

Installation Sheet

Module Front

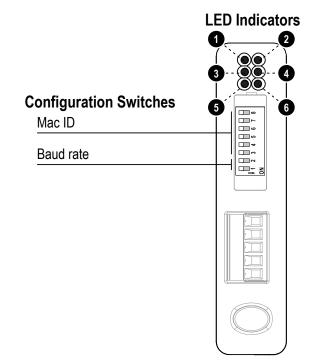

LED no	Indication	Meaning		
1 (Network Status)	Off Green Flashing green Red Flashing red	Not online Link ok, online, connected Online, not connected Critical link failure Connection timeout		
2 (Module Status)	Off Green Flashing green Red Flashing red	No power Device operational Data size bigger than configured Unrecoverable fault Minor fault		
3, 4 (Not used)	-	-		
5 (Subnet Status)	Flashing green Green Red	Running, but one or more transaction error Running Transaction error/timeout or subnet stopp		
6 (Device Status) Off Alternating red/green Green Flashing green Red Flashing red		Power off Invalid or missing configuration Initializing Running Bootloader mode Note the flash sequence pattern and contact the HMS support department		

Configuration Switches

Baud rate	Sw. 1	Sw. 2
125k	OFF	OFF
250k	OFF	ON
500k	ON	OFF
(reserved)	ON	ON

PC Connector:	Subnet	Subnetwork Connector		
1. GND 2. GND	Pin no.	Description		
3. RS232 Rx 4. RS232 Tx	1	+5V OUT		
	2	RS232 Rx		
	3	RS232 Tx		
	•••• 4	NC		
	5	Signal GND		
Dowor	6	RS422 Rx+		

RS422 Rx-

RS485+ / RS422 Tx+

RS485- / RS422 Tx-

9

Mac ID	Sw. 3	Sw. 4	Sw. 5	Sw. 6	Sw. 7	Sw. 8
0	OFF	OFF	OFF	OFF	OFF	OFF
1	OFF	OFF	OFF	OFF	OFF	ON
2	OFF	OFF	OFF	OFF	ON	OFF
3 - 62						
63	ON	ON	ON	ON	ON	ON

DeviceNet Connector

	Pin no	Description
	1	V-
	2	CAN L
s s 5	3	Shield
	4	CAN H
	5	V+

Accessories Checklist

The following items are required for installation:

- Anybus Communicator Resource CD (Includes configuration . software, manuals, EDS file and application notes)
- RS232 configuration cable
- Subnetwork connector
- DeviceNet network cable and connector (not included)

Installation and Startup Summary

- Mount the Communicator on the DIN-rail.
- Connect the Communicator to the DeviceNet network. .
- Connect the Communicator to the subnetwork.
- Power on the Communicator (+24 V DC).
- Connect the configuration cable between the Communicator and the PC containing the Anybus Configuration Manager software (ACM).
- Configure the Communicator using ACM.
- Include the Anybus Communicator EDS file in the . DeviceNet configuration tool.
- Configure and start the DeviceNet network.

Further information and documents about this product can be found at the product pages on www.anybus.com.

Bottom View Power: 7 1. +24 V DC 2. GND 8

UL Certification



Warnings

- WARNING EXPLOSION HAZARD SUBSTITUTION OF ANY COMPONENTS MAY IMPAIR SUITABILITY FOR CLASS I, DIVISION 2.
- WARNING EXPLOSION HAZARD WHEN IN HAZARDOUS LOCATIONS, TURN OFF POWER BEFORE REPLACING OR WIRING MODULES.
- WARNING EXPLOSION HAZARD DO NOT DISCONNECT EQUIPMENT UNLESS POWER HAS BEEN SWITCHED OFF OR THE AREA IS KNOWN TO BE NONHAZARDOUS.

Additional installation and operating instructions

Max Ambient Temperature: 55°C (for Hazloc environments)

Field wiring terminal markings (wire type (Cu only, 14-30 AWG)).

Use 60/75 or 75°C copper (Cu) wire only.

Terminal tightening torque must be between 5-7 lb-in (0.5 - 0.8 $\ensuremath{\mathsf{Nm}}\xspace$).

Use in overvoltage category 1 pollution degree 2 environment.

Installed in an enclosure considered representative of the intended use.

Secondary circuit intended to be supplied from an isolating source and protected by overcurrent protective devices installed in the field sized per the following:

Control-circuit Wire Size		Maximum Protective Devic Rating	
AWG	(mm ²)	Amperes	
22	(0.32)	3	
20	(0.52)	5	
18	(0.82)	7	
16	(1.3)	10	
14	(2.1)	20	
12	(3.3)	25	

EMC Compliance (CE)



This product is in accordance with the EMC directive 89/336/EEC, with amendments 92/31/EEC and 93/68/EEC through conformance with the following standards:

- **EN 50082-2 (1993)** EN 55011 (1990) Class A
- EN 61000-6-2 (1999) EN 61000-4-3 (1996) 10 V/m EN 61000-4-6 (1996) 10 V/m (all ports) EN 61000-4-2 (1995) ±8 kV Air Discharge ±4 kV Contact discharge EN 61000-4-4 (1995) ±2 kV Power port ±1 kV Other ports EN 61000-4-5 (1995) ±0.5 kV Power ports (DM/CM) ±1 kV Signal ports

Attention!

- ATTENTION RISQUE D'EXPLOSION LE REM-PLACEMENT DE TOUT COMPOSANTS INVALIDE LA CERTIFICATION CLASS I, DIVISION 2.
- ATTENTION RISQUE D'EXPLOSION EN ZONE EXPLOSIVE, VEUILLEZ COUPER L'ALIMENTATION ÉLECTRIQUE AVANT LE REMPLACEMENT OU LE RACCORDEMENT DES MODULES.
- ATTENTION RISQUE D'EXPLOSION NE PAS DÉCONNECTER L'ÉQUIPEMENT TANT QUE L'ALIMENTATION EST TOUJOURS PRÉSENTE OU QUE LE PRODUIT EST TOUJOURS EN ZONE EXPLO-SIVE ACTIVE.

ODVA Compliance

DeviceNet CONFORMANCE TESTED[™] is a certification mark of ODVA.

Further information and documents about this product can be found at the product pages on www.anybus.com.