SAFETY ORGANIZATIONS

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET:

UL RECOGNIZED: UL 1283

CSA CERTIFIED: CSA C22.2 No. 8 VDE APPROVEO: EN 60939-2

OPERATING SPECIFICATIONS

LINE CURRENT/VOLTAGE: 42 AMP 277 VAC LINE TO GROUND

42 AMP 480 VAC PHASE TO PHASE

LINE FREQUENCY:

MAXIMUM LEAKAGE CURRENT,

EACH LINE TO GROUND:

30mA @ 277VAC 50 HZ

OPERATING AMBIENT TEMP. RANGE: -10°C TO +50°C @ RATED CURRENT, In.

IN AN AMBIENT, I_0 , HIGHER THAN 50°C, THE MAXIMUM OPERATING CURRENT, I_0 , IS AS FOLLOWS: $I_0 = I_{\infty} - \sqrt{100 - I_0}$

 $100 - T_0$ $I_0 = I_r$ 50

RELIABILITY SPECIFICATIONS:

STORAGE TEMPERATURE: ~40°C TO +85°C HUMIDITY: 21 DAYS @ 50°C 95% RH. CURRENT OVERLOAD TEST: 6 TIMES 1, FOR

CUSTOMER DRAWING CATALOG # 42BCF6 ECN# APPRVD DATE TAM 15-011624 08DEC15

TEST SPECIFICATIONS:

INDUCTANCE: 1.19 mH NOMINAL CAPACITANCE: (MEASURED @ 1KHz, 0.250VAC MAX., 25°C±1°C)

LINE TO GROUND:

μF±20% 2.17 μF±20% 6.60

LINE TO LINE:

660K

DISCHARGE RESISTOR: NO DISCHARGE RESISTOR:

660K A. 6000MA (MIN.) 100VDC,


20°C AND 50% RH@

RECOMMENDED RECEIVING INSPECTION HIPOT:

LINE TO GROUND: 1850 VDC FOR 1 MINUTE 1850 VDC FOR 1 MINUTE LINE TO LINE:

FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

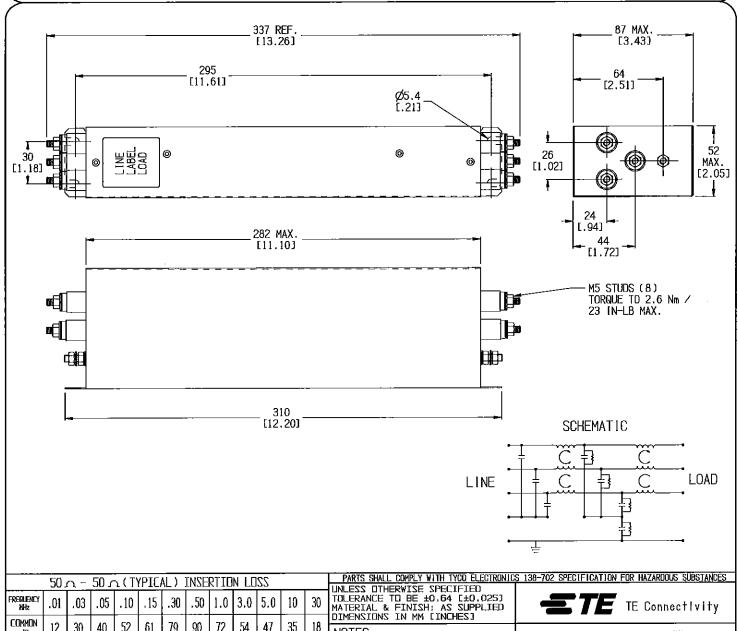

52 35 12 30 40 61 79 90 72 54 47 18 ďЯ DIFF. 13 35 36 82 69 59 55 40 50 d8 SHEET STA THIS INFORMATION IS CONFIDENTIAL AND PROPRIETARY TO TYCO ELECTRONICS CORPORATION AND ITS VERLINIES RESIDIARIES AND AFFILIATES. IT HAY NOT RE DISCUSSIFIED TO ANYONG THERE THAN TYCO ELECTRONICS PRESIDENT, WITHOUT MUSTIFER AUTHORIZATION FROM TYCO ELECTRONICS CORPORATION.

WITHOUT AUTHORIZATION FROM TYCO ELECTRONICS CORPORATION.

NOTES:

4280F6-A.okd

CUSTOMER DRAWING

TE PART ND.: 2-1609091-8 TRAVIAL NUMBER: SCALE: NTS 300CT15 42BCF6 A