

QT-Brightek Chip LED Series

SMD 0603 Blue LED

Part No.: QBLP601-2IB5

2IB: Blue 460 to 470nm

5: 5mA

Table of Contents:

| | |
|--|---|
| Introduction | 3 |
| Electrical / Optical Characteristic (Ta=25 °C) | 4 |
| Absolute Maximum Rating | 4 |
| Solder Profile & Footprint | 6 |
| Packing | 7 |
| Ordering Information | 8 |
| Revision History | 9 |
| Disclaimer | 9 |

Introduction

Feature:

- Water clear lens
- Color: Blue
- Package in tape and reel
- Ultra bright 0603 LED package
- InGaN technology
- Viewing angle: 140 deg typ.

Description:

These ultra bright 0603 LEDs have a height profile of 0.60mm. Combination of high brightness output and small footprint, these LEDs are ideal for keypad backlighting and status indication.

Application:


- Status indication
- Back lighting application

Certification & Compliance:

- ISO9001
- RoHS Compliant



Dimension:

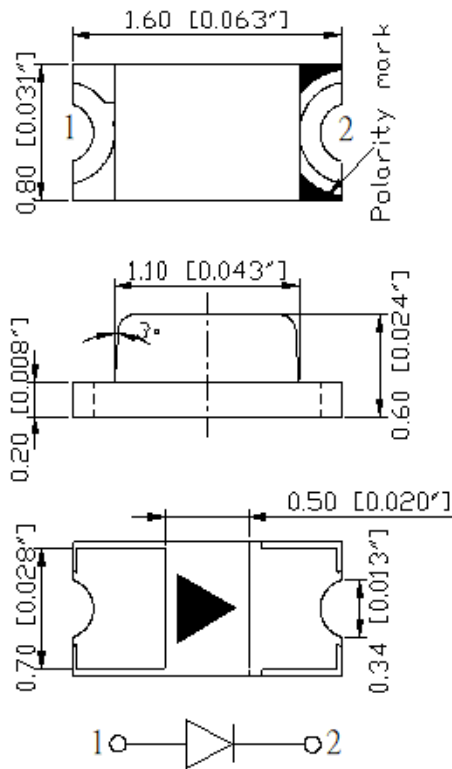

Units: mm / tolerance = +/-0.1mm

Electrical / Optical Characteristic (Ta=25 °C)

| Product | Color | I _F (mA) | V _F (V) | | λ _D (nm) | | | I _V (mcd) | |
|--------------|-------|---------------------|--------------------|------|---------------------|------|------|----------------------|------|
| | | | Typ. | Max. | Min. | Typ. | Max. | Min. | Typ. |
| QBLP601-2IB5 | Blue | 5 | 2.7 | 3.1 | 460 | 465 | 470 | 20 | 35 |

Absolute Maximum Rating

| Material | P _d (mW) | I _F (mA) | I _{FP} (mA)* | V _R (V) | T _{OP} (°C) | T _{ST} (°C) | T _{SO L} (°C)** |
|----------|---------------------|---------------------|-----------------------|--------------------|----------------------|----------------------|--------------------------|
| InGaN | 93 | 30 | 125 | 5 | -40 ~ +80 | -40 ~ +85 | 260 |

*Duty 1/8 @ 1KHz

**IR Reflow for no more than 10 sec @ 260 °C

Forward Voltage V_F @ I_F=5mA

| Bin | Min. | Max. | Unit |
|-----|------|------|------|
| e | 2.5 | 2.8 | V |
| f | 2.8 | 3.1 | |


Luminous Intensity I_V @ I_F=5mA

| Bin | Min. | Max. | Unit |
|-----|------|------|------|
| C | 20 | 25 | mcd |
| D | 25 | 32 | |
| E | 32 | 40 | |
| F | 40 | 50 | |
| G | 50 | 63 | |

Dominant Wavelength λ_D @ I_F=5mA


| Bin | Min. | Max. | Unit |
|-----|------|------|------|
| B0 | 460 | 465 | nm |
| B1 | 465 | 470 | |

Characteristic Curves

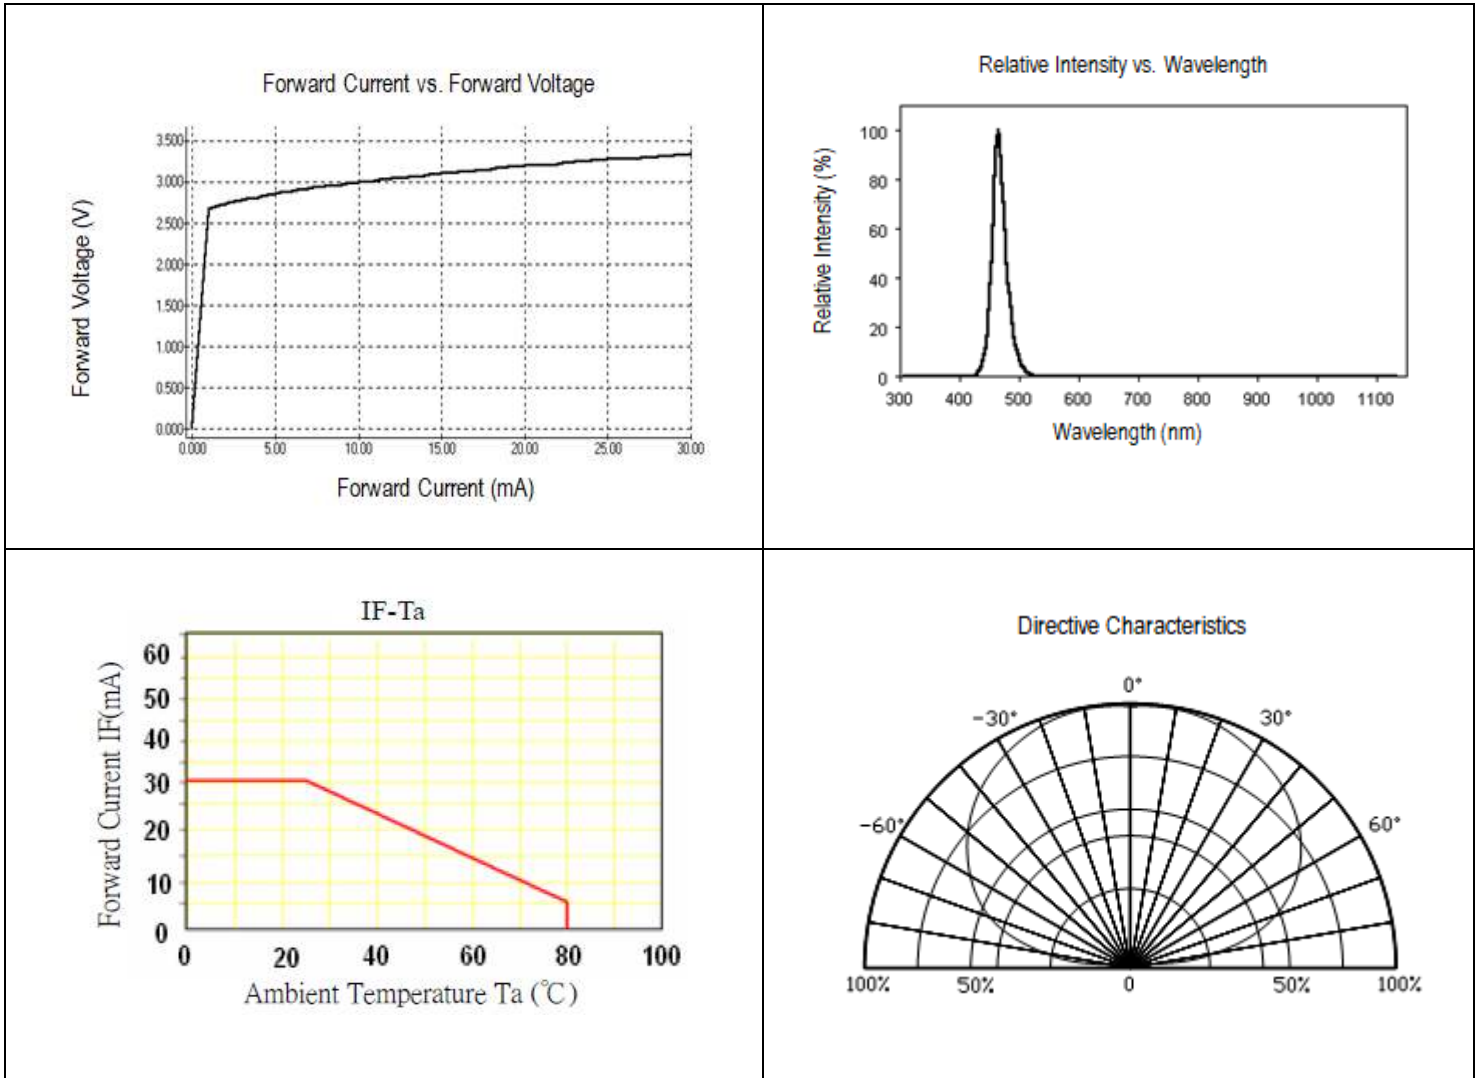


Solder Profile & Footprint

-The recommended reflow soldering profile is as follows (temperatures indicated are as measured on the surface of the LED resin):

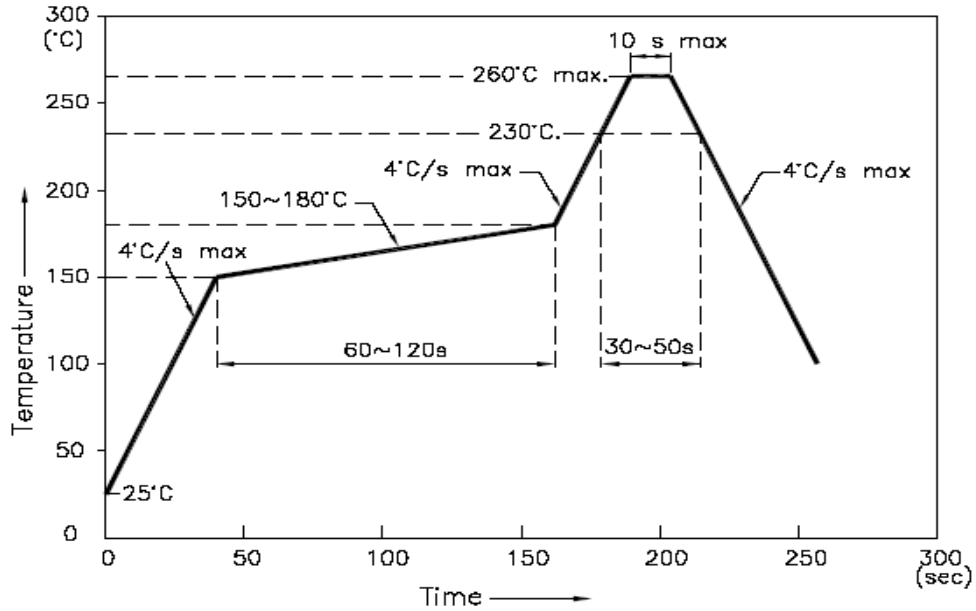

Recommended Pad Layout

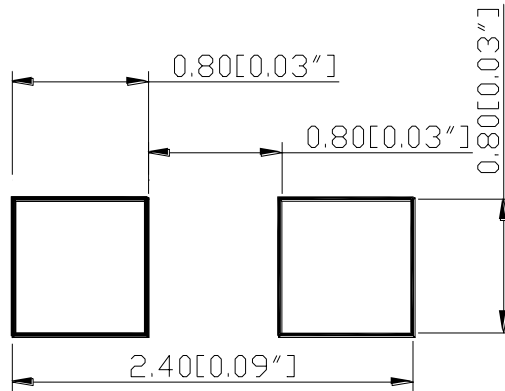


Units: mm

Tolerance: ± 0.1 mm


Packing

Reel Dimension:

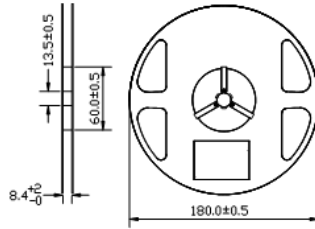


Unit: mm

Tape Dimension:

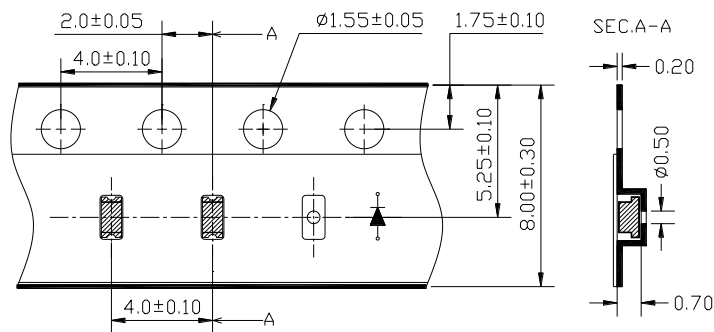


Unit: mm

Arrangement of Tape:

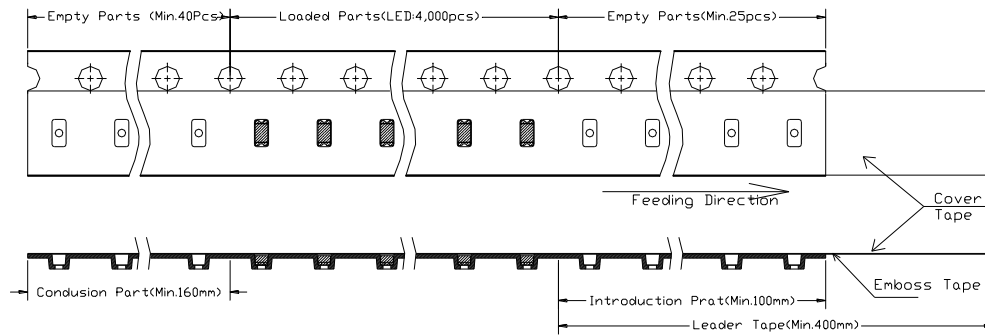

Packaging Specifications:

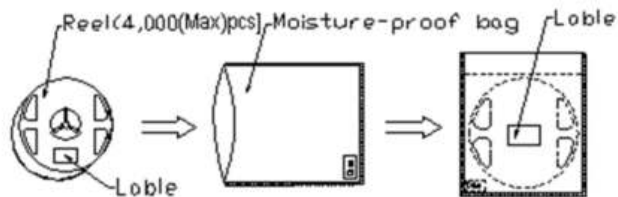



Ordering Information

| Part # | Orderable Part # | Spec Range | Quantity per reel |
|--------------|------------------|---|-------------------|
| QBLP601-2IB5 | QBLP601-2IB5 | Iv=35mcd typ. @ I _F =5mA / Color=460 to 470nm | 4,000 units |

Revision History

| Description: | Revision # | Revision Date |
|-----------------------------|------------|---------------|
| New Release of QBLP601-2IB5 | V1.0 | 09/01/2021 |
| | | |
| | | |
| | | |

Disclaimer

QT-BRIGHTTEK reserves the right to make changes without further notice to any products herein to improve reliability, function or design. QT-BRIGHTTEK does not assume any liability arising out of the application or use of any product or circuit described herein; neither does it convey any license under its patent rights, nor the rights of others.

Life Support Policy

QT-BRIGHTTEK's products are not authorized for use as critical components in life support devices or systems without the express written approval of QT-BRIGHTTEK. As used herein:

1. Life support devices or systems are devices or systems which, (a) are intended for surgical implant into the body, or (b) support or sustain life, and (c) whose failure to perform when properly used in accordance with instructions for use provided in the labeling, can be reasonably expected to result in a significant injury of the user.
2. A critical component in any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.