

D4E225-CC01-30

AC centrifugal fan

forward-curved, dual-intake

with housing (large flange)



ebm-papst Mulfingen GmbH & Co. KG

Bachmühle 2 · D-74673 Mulfingen

Phone +49 7938 81-0

Fax +49 7938 81-110

info1@de.ebmpapst.com

www.ebmpapst.com

Limited partnership · Headquarters Mulfingen

Amtsgericht (court of registration) Stuttgart · HRA 590344

General partner Elektrobau Mulfingen GmbH · Headquarters Mulfingen

Amtsgericht (court of registration) Stuttgart · HRB 590142

Nominal data

| | | |
|-----------------------------|-------------------|---------|
| Type | D4E225-CC01-30 | |
| Motor | M4E074-LA | |
| Phase | | 1~ |
| Nominal voltage | VAC | 230 |
| Frequency | Hz | 50 |
| Method of obtaining data | | ml |
| Valid for approval/standard | | CE |
| Speed (rpm) | min ⁻¹ | 1210 |
| Power consumption | W | 540 |
| Current draw | A | 2.4 |
| Capacitor | µF | 16 |
| Capacitor voltage | VDB | 400 |
| Capacitor standard | | S2 (CE) |
| Min. back pressure | Pa | 250 |
| Min. back pressure | in. wg | 1 |
| Min. ambient temperature | °C | -25 |
| Max. ambient temperature | °C | 30 |

ml = Max. load · me = Max. efficiency · fa = Free air · cs = Customer specification · ce = Customer equipment
Subject to change

Data according to Commission Regulation (EU) 327/2011

| | | Actual | Req. 2015 |
|--------------------------------|---|--------|-----------|
| 01 Overall efficiency η_e | % | 40.2 | 40.2 |
| 02 Measurement category | | B | |
| 03 Efficiency category | | Total | |
| 04 Efficiency grade N | | 49 | 49 |
| 05 Variable speed drive | | No | |

Data obtained at optimum efficiency level.

The ErP data is determined using a motor-impeller combination in a standardized measurement setup.

| | | |
|----------------------------|-------------------|------|
| 09 Power consumption P_e | kW | 0.4 |
| 09 Air flow q_v | m ³ /h | 1595 |
| 09 Pressure increase p_f | Pa | 355 |
| 10 Speed (rpm) n | min ⁻¹ | 1345 |
| 11 Specific ratio* | | 1.00 |

* Specific ratio = $1 + p_f / 100\,000\text{ Pa}$

LU-135956



AC centrifugal fan

forward-curved, dual-intake
with housing (large flange)

Technical description


| | |
|---|--|
| Weight | 13 kg |
| Fan size | 225 mm |
| Impeller material | Sheet steel, galvanized |
| Housing material | Sheet steel, galvanized |
| Support structure material | Sheet steel, galvanized |
| Motor suspension | Motor vibration-damped on both sides |
| Direction of rotation | Counterclockwise, viewed toward rotor |
| Degree of protection | IP22 |
| Insulation class | "B" |
| Moisture (F) / Environmental (H) protection class | F2-1 |
| Max. permitted ambient temp. for motor (transport/storage) | + 80 °C |
| Min. permitted ambient temp. for motor (transport/storage) | - 40 °C |
| Installation position | Any |
| Condensation drainage holes | None, open rotor |
| Mode | S1 |
| Motor bearing | Ball bearing |
| Touch current according to IEC 60990 (measuring circuit Fig. 4, TN system) | < 0.75 mA |
| Motor protection | Thermal overload protector (TOP) with basic insulation |
| Protection class | I (with customer connection of protective earth) |
| Conformity with standards | EN 60335-1; CE |
| Approval | CCC |



AC centrifugal fan


forward-curved, dual-intake
with housing (large flange)

Product drawing

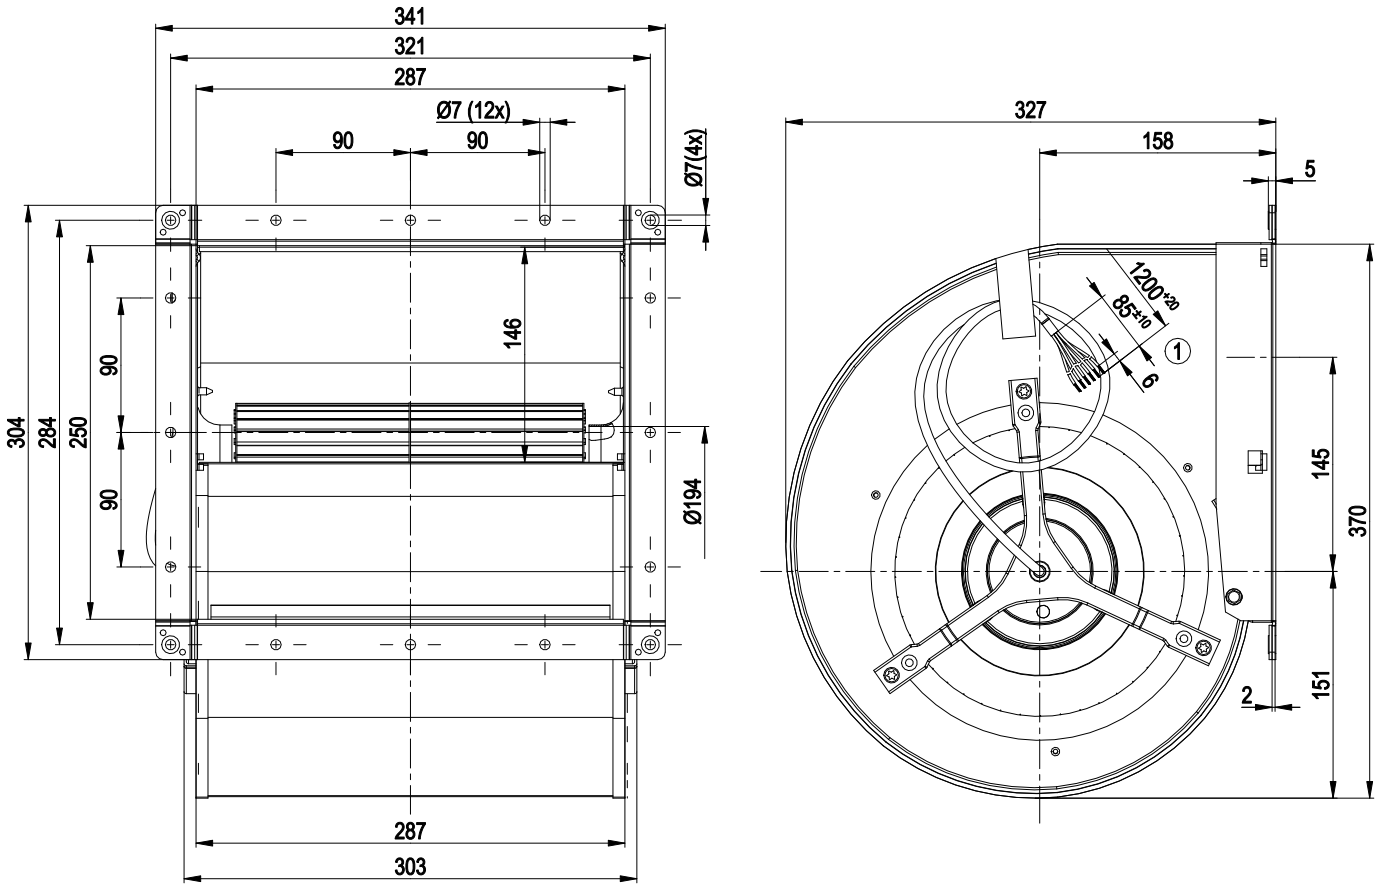

1 Cable ETFE AWG20 0.5 mm², 6x crimped splices

Connection diagram

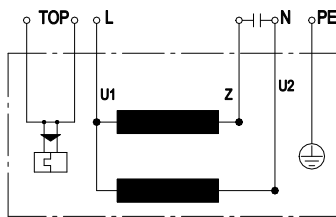


| | | | | | |
|----|--------------|-----|---------|----|-------|
| U1 | blue | Z | brown | U2 | black |
| PE | green/yellow | TOP | 2x gray | | |



AC centrifugal fan

forward-curved, dual-intake
with housing (large flange)

Curves: Air performance 50 Hz

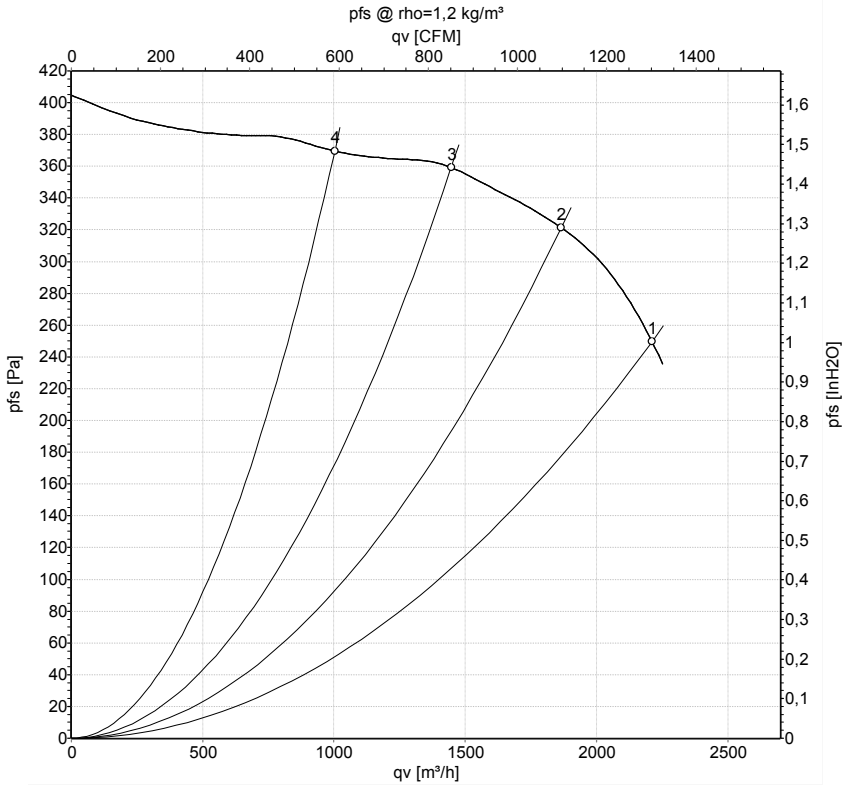

Measurement: LU-135956-1

Air performance measured according to ISO 5801 installation category A. For detailed information on the measurement setup, contact ebm-papst. Intake sound level: Sound power level according to ISO 13347 / sound pressure level measured at 1 m distance from fan axis. The values given are valid under the specified measuring conditions and may vary due to conditions of installation. For deviations from the standard configuration, the parameters have to be checked on the installed unit.

Measured values

| | U | f | n | P _e | I | q _v | P _{fs} | q _v | P _{fs} |
|---|-----|----|-------------------|----------------|------|-------------------|-----------------|----------------|-----------------|
| | V | Hz | min ⁻¹ | W | A | m ³ /h | Pa | cfm | in. wg |
| 1 | 230 | 50 | 1210 | 540 | 2.40 | 2210 | 250 | 1300 | 1.00 |
| 2 | 230 | 50 | 1300 | 459 | 2.04 | 1865 | 320 | 1100 | 1.28 |
| 3 | 230 | 50 | 1365 | 378 | 1.71 | 1445 | 360 | 850 | 1.45 |
| 4 | 230 | 50 | 1405 | 320 | 1.48 | 1005 | 370 | 590 | 1.49 |

U = Power supply · f = Frequency · n = Speed (rpm) · P_e = Power consumption · I = Current draw · q_v = Air flow · P_{fs} = Pressure increase

