
# R series (10A

-10 -223

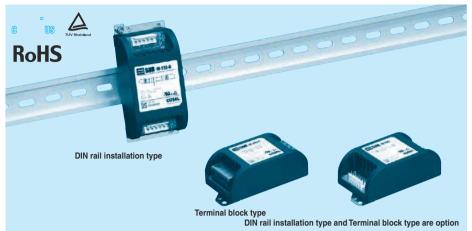

①Model Name ②Rated Current

3 Line to ground capacitor code: See table 1.1.

table1.1 Line to ground capacitor code

Code	Line to ground capacitor (nominal value)	
000	Not Provided	
223	22000pF	

(4)Options

D :DIN rail installation type
T :Terminal block type

DT:Terminal block and DIN rail type

\* The dimensions change when the option is set. Refer to External view.

## Features of SNR series (10A)

# Ripple noise attenuation type for switch mode power supplies(DC)

· 50 VDC


· Best filter for switch mode power supplies of analog circuits

### **Specifications**

No.	Itama	SNR-10-223
	Items	Interface:Connector
1	Rated Voltage DC[V]	50
2	Rated Current DC[A] *1	10 (Peak 20)
3	Test Voltage (Terminal-Mounting Plate)	500 VAC (Cutoff Current = 100mA), 1 minute at room temperature and humidity
4	Isolation Resistance (Terminal-Mounting Plate)	500 VDC 50M $\Omega$ min at room temperature and humidity
5	DC resistance	$20m\Omega$ max
6	Operating temperature	-40 to +71 ℃ (Refer to Derating Curve)
7	Operating humidity	20 to 95%RH (Non condensing)
8	Storage temperature/humidity	-40 to +75°C/20 to 95%RH (Non condensing)
9	Vibration	10 to 55Hz, 19.6m/s² (2G), 3min. Period, 1hour each X, Y and Z axis
10	Impact	196.1m/s² (20G), 11ms Once each X, Y and Z axis
11	Safety agency approvals	UL60950-1, C-UL (CSA60950-1), IEC60950-1
12	Case size (without projection) /Weight	52×35×117 mm [2.05×1.38×4.61 inches] (W×H×D) /140g max (Option : -D, -T, -DT refer to external view)

<sup>\*1</sup> Peak current for 10 sec. And Duty 35% max, refer to Instruction Manual 5. In detail.


## **Circuit Diagram**



CY: Line to ground capacitor Co: Electrolytic capacitor  $\frac{\perp}{=}$ : Mounting Plate

■Expected life: 10 years

# **Derating Curve**






#### **External view**

#### **Standard Type**


#### Terminal block Type

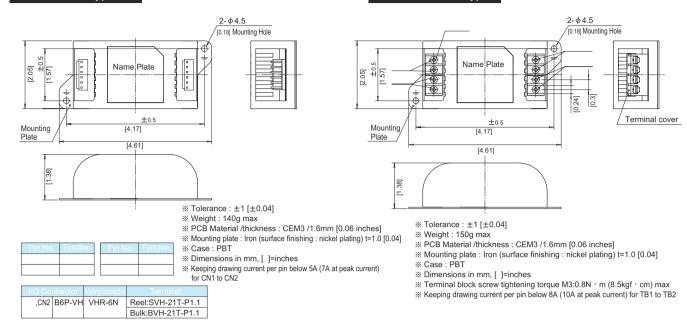

Option harness: Refer to Instruction Manual 4

#### **DIN rail installation Type**

# Terminal block type+DIN rail installation Type

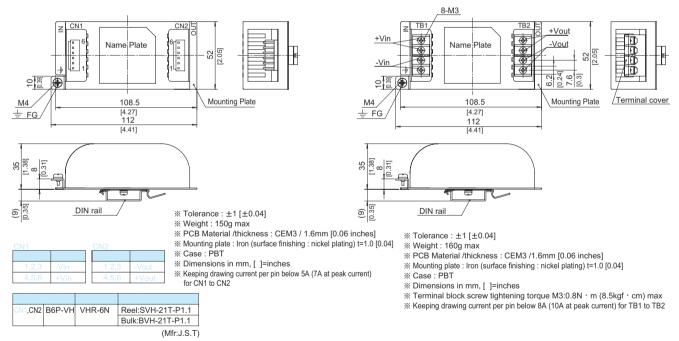

Option harness: Refer to Instruction Manual 4

## ■Note when installing the EMI/EMC Filter on a DIN rail.

When the EMI/EMC Filter is grounded through the DIN rail, the proper noise attenuation may not be achieved.

Be sure to connect the FG terminal of the EMI/ EMC Filter body to the earth.

