Specifications are subject to change without notice (08.06.10)

Monitoring Relays 1-Phase True RMS AC/DC Over or Under Voltage Types DUB01, PUB01

Product Description DUB01 and PUB01 are pre-

DUB01

cise TRMS AC/DC over or under voltage (selectable by DIP-switch) monitoring relays.

Owing to the built-in latch function, the ON-position of the relay output can be maintained. Inhibit function can be used to avoid relay operation when not desired (maintenance, transitions). The LED's indicate the state of the alarm and the output relay.

•	TRMS AC/DC over or under voltage	
	monitoring relays	

- Selection of measuring range by DIP-switches
- Measuring ranges from 0.1 to 500 V AC/DC
- Adjustable voltage on relative scale
- Adjustable hysteresis on relative scale
- Adjustable delay function (0.1 to 30 s)
- Programmable latching or inhibit at set level •
- Output: 8 A SPDT relay N.D. or N.E. selectable For mounting on DIN-rail in accordance with
- DIN/EN 50 022 (DUB01) or plug-in module (PUB01) 22.5 mm Euronorm housing (DUB01)
- or 36 mm plug-in module (PUB01)
- LED indication for relay, alarm and power supply ON

Ordering Key DUB 01 C B23 10V Housing Function Type Item number Output Power supply Range


Type Selection

Mounting	Output	Measuring range	Supply: 24 to 48 VAC/DC	Supply: 115/230 VAC
DIN-rail	SPDT	0.1 to 10 V AC/DC 2 to 500 V AC/DC	DUB 01 C D48 10V DUB 01 C D48 500V	DUB 01 C B23 10V DUB 01 C B23 500V
Plug-in	SPDT	0.1 to 10 V AC/DC 2 to 500 V AC/DC	PUB 01 C D48 10V PUB 01 C D48 500V	PUB 01 C B23 10V PUB 01 C B23 500V

Input Specifications

Input (voltage level) DUB01 PUB01	Terminals Y1, Y2 Terminals 5, 7		Contact input DUB01 PUB01	Terminals Z1, Y1 Terminals 8, 9
Measuring ranges Direct Selectable by DIP-switches 10V: 0.1 to 1 V AC/DC 0.2 to 2 V AC/DC 0.5 to 5 V AC/DC 1 to 10 V AC/DC Max. voltage for 1 s	Int. resist. >200 kΩ >200 kΩ >200 kΩ >200 kΩ	Max. volt. 100 V 100 V 100 V 100 V 200 V	Disabled Enabled Latch disable	> 10 kΩ < 500 Ω > 500 ms
500V: 2 to 20 V AC/DC 5 to 50 V AC/DC 20 to 200 V AC/DC 50 to 500 V AC/DC Max. voltage for 1 s Note: The input voltage cannot raise over 300 VAC/DC with respect to ground (PUB01 only)	>500 kΩ >500 kΩ >500 kΩ >500 kΩ	350 V 350 V 600 V 600 V 1000 V		

CARLO GAVAZZI





Output Specifications

Output Rated insulation voltage	SPDT relay 250 VAC
Contact ratings (AgSnO ₂) Resistive loads AC 1 DC 12 Small inductive loads AC 15 DC 13	μ 8 A @ 250 VAC 5 A @ 24 VDC 2.5 A @ 250 VAC 2.5 A @ 24 VDC
Mechanical life	≥ 30 x 10 ⁶ operations
Electrical life	\geq 10 ⁵ operations (at 8 A, 250 V, cos ϕ = 1)
Operating frequency	\leq 7200 operations/h
Dielectric strength Dielectric voltage Rated impulse withstand volt.	≥ 2 kVAC (rms) 4 kV (1.2/50 μs)

Supply Specifications

Power supply Rated operational voltage through terminals: A1, A2 or A3, A2 (DUB01) 2, 10 or 11, 10 (PUB01)	Overvoltage cat. III (IEC 60664, IEC 60038)
D48:	24 to 48 VAC/DC ± 15% 45 to 65 Hz, insulated
B23:	115/230 VAC ± 15% 45 to 65 Hz, insulated
Dielectric voltage	DC supply AC supply
Supply to input	2 kV 4 kV
Supply to output	4 kV 4 kV
Input to output	4 kV 4 kV
Rated operational power	
AC	4 VA
DC	3 W

General Specifications

$1 s \pm 0.5 s \text{ or } 6 s \pm 0.5 s$
(input signal variation from -20% to +20% or from +20% to -20% of set value) < 100 ms
< 100 ms
(15 min warm-up time) \pm 1000 ppm/°C \pm 10% on set value \pm 50 ms \pm 0.5% on full-scale
LED, green LED, red (flashing 2 Hz during delay time) LED, yellow
,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,
IP 20 3 (DUB01), 2 (PUB01) -20 to 60°C, R.H. < 95% -30 to 80°C, R.H. < 95%
22.5 x 80 x 99.5 mm 36 x 80 x 94 mm
PA66 or Noryl
Approx. 150 g
Max. 0.5 Nm acc. to IEC 60947
EN 60255-6
UL, CSA
L.V. Directive 2006/95/EC EMC Directive 2004/108/EC
According to EN 60255-26 According to EN 61000-6-2
According to EN 61000-0-2 According to EN 60255-26 According to EN 61000-6-3

Mode of Operation

DUB01 and PUB01 monitor both AC and DC over or under voltage.

Example 1

(no connection between terminals Z1, Y1 or 8, 9 - latch function disabled)

The relay operates when the measured value exceeds (or drops below) the set level for more than the set delay time.

It releases when the voltage

drops below (or exceeds) the set level (see hysteresis setting), or when power supply is interrupted.

Example 2


(connection between terminals Z1, Y1 or 8, 9 - latch function enabled)

The relay operates and latches in operating position when the measured value exceeds (or drops below) the set level for more than the set delay time. Provided that the voltage has dropped below (or has exceeded) the set point (see hysteresis setting) the relay releases when the interconnection between terminals Z1, Y1 or 8, 9 is interrupted, or power supply is interrupted as well.

The red LED flashes until the delay time has expired or the measured value has dropped below the set point (see hysteresis setting).

Note

When the inhibit contact is opened, if the input signal is already in alarm position, the delay time needs to elapse before relay activation.



Function/Range/Level and Time Delay Setting


Adjust the input range setting the DIP switches 1 and 2 as shown below. Select the desired function setting the DIP switches 3 to

6 as shown below. To access the DIP switches open the grey plastic cover as shown below.


Upper knob: Setting of hysteresis tive scale: 0 to 30% on set value.

Selection of level and time delay:	Voltage level sett	
	tive scale: 10 to	
Upper knob:	full scale.	
Setting of hysteresis on rela-		

Centre knob: ting on relao 110% on Lower knob: Setting of delay on alarm time on absolute scale (0.1 to 30 s).

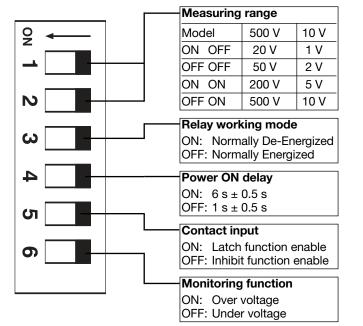


Operation Diagrams

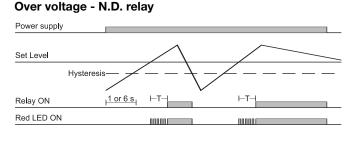


Under voltage - Latch function - N.D. relay

Over voltage - Inhibit function - N.D. relay

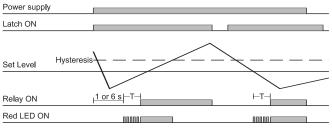

Under voltage - N.D. relay

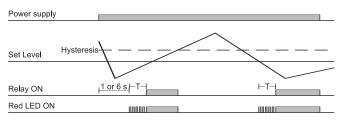


Power supply Inhibit ON Set Level Hysteresis 1 or 6 s ⊢T• ⊢T-Relay ON H-T-Red LED ON попол nnnnf

3

CARLO GAVAZZI



Wiring Diagrams

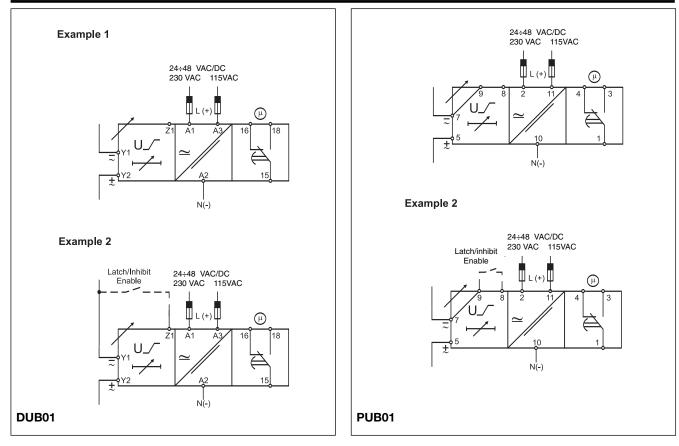

Dimensions

