


PANDUIT PART NUMBER		WIRE RANGE AWG	MAX. WIRE INSUL. DIA.	DIMENSIONS in.			HOUSING COLOR
PREFIX	PKG			A $\pm .03$	B $\pm .01$	C $\pm .002$	
DNF18-250M	-C -M	22-18	.136 (3,5)	.90 (22,9)	.25 (6,4)	.032 (0,81)	RED
DNF14-250M	-C -M	16-14	.162 (4,1)	.90 (22,9)	.25 (6,4)	.032 (0,81)	BLUE
DNF10-250M*	-L -D	12-10	.230 (5,8)	1.03 (26,2)	.25 (6,4)	.032 (0,81)	YELLOW

\*NOT UL LISTED OR CSA CERTIFIED

NOTES:

- CSA CERTIFIED FOR:
  - A. 600V. MAX. VOLTAGE RATING
  - B. 221° F (105° C) MAX. TEMP. RATING
  - C. FOR STRANDED COPPER WIRE ONLY
- MATERIAL:
  - A. STAMPING - .032 (.81) THK COPPER, NICKEL PLATED
  - B. HOUSING - NYLON
  - C. SLEEVE - BRASS, TIN PLATED
- PACKAGE QTY: STD. PKG.    -L=50  
 -C=100  
 BULK PKG.                -D=500  
 -M=1000
- DIMENSIONS IN BRACKETS ARE IN MILLIMETERS
- INSTALLATION TOOLS:
  - A. CSA CERTIFIED: CT-100, CT-1550, CT-1551
  - B. PANDUIT APPROVED: CT-160, CT-260
- WIRE STRIP LENGTH:  $9/32^{+1/32}_0$  (7.1  $^{+0.8}_0$ )

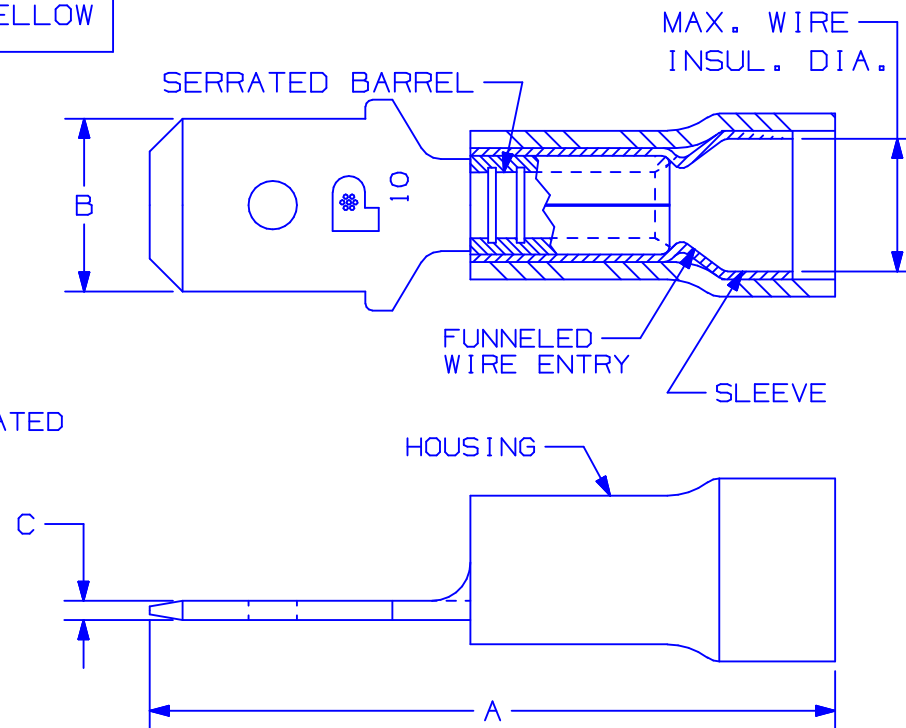

CERTIFIED  
LR31212

A41322\_08

08	11/04	KLFU		ADDED LOGO AND MARKING 10			
07	7/01	JAMB	RLS	ADDED PACKAGING COLUMN TO TABLE	09498	TRO	JAC
06	1/01	RM	SKB	FILESPEC WAS N41322AA_PCD_05	08925	TRO	JCJ
05	10/00	SB	SKB	ADDED DNF10-250M AND REMOVED CT-500 & CT-550 TOOLS	08739	TRO	JCJ
04	3/99	JD	SKB	ADDED CT-1551 & CT-1550 TOOLS	07634	TRO	JCJ
REV	DATE	BY	CHK	DESCRIPTION	ECN #	PM	CUST

**PANDUIT** CORP.

TINLEY PARK, ILLINOIS

NYLON INSULATED MALE DISCONNECT  
FUNNELED WIRE ENTRY  
.250 X .032 (6.35 X 0.81) MALE TAB

DRAWN BY DAW    CHK'D RLS    SCALE NONE    DRAWING NO. A41322