

SPECIFICATION FOR APPROVAL

| Customer. Sid | |
|--|------------------------|
| Description: DC FAN | |
| Customer Part No. | REV.: |
| Delta Model No. : PFC1448HEE79 | REV.: 03 |
| Sample Issue No. : | |
| Sample Issue Date: MAY.13 2020 | |
| | |
| | |
| | |
| | |
| PLEASE SEND ONE COPY OF THIS SPI YOU SIGNED APPROVAL FOR PRODUC | |
| TOO SIGNED APPROVAL FOR PRODUC | STION PRE-ARRANGIMENT. |
| APPROVED BY: | |
| | |
| DATE : | |
| | |
| | |

DELTA ELECTRONICS, INC.
TAOYUAN PLANT
252, SHANGYING ROAD, GUISHAN INDUSTRIAL ZONE,
TAOYUAN CITY 33341, TAIWAN

TEL:886-(0)3-3591968 FAX:886-(0)3-3591991

Customer:

STD

STATEMENT OF DEVIATION

TEL: 886-(0)3-3591968

FAX: 886-(0)3-3591991

| ■ NONE □ DESCRIPTION: | | |
|------------------------|--|--|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

DELTA ELECTRONICS, INC. 252, SHANGYING ROAD, GUISHAN INDUSTRIAL ZONE, TAOYUAN CITY 33341, TAIWAN

Specification For Approval

TEL: 886-(0)3-3591968

FAX: 886-(0)3-3591991

| Customer : | STD | | | | |
|---------------|------------|--------------|-------------------------|-----|--|
| Description : | DC FAN | | | | |
| Customer P/I | N : | | rev. : | | |
| Delta model ı | no. : | PFC1448HEE79 | Delta Safety Model No.: | N/A | |
| Sample revis | ion. : | 03 | Issue no.: | | |
| Sample issue | e date : M | AY.13 2020 | Quantity : | | |

1. SCOPE:

THIS SPECIFICATION DEFINES THE ELECTRICAL AND MECHANICAL CHARACTERISTICS OF THE DC BRUSHLESS AXIAL FLOW FAN.

2. CHARACTERS:

| ITEM | DESCRIPTION |
|---------------------------|--|
| RATED VOLTAGE | 48 VDC |
| OPERATION VOLTAGE | 36.0 - 60.0 VDC |
| INDUT CURRENT/AVC \ | 1.1 (MAX 1.32) A |
| INPUT CURRENT(AVG.) | CURRENT ON LABEL: 2.50A |
| INPUT POWER(AVG.) | 52.8 (MAX. 63.36) W |
| SPEED | 8000 ± 10% R.P.M. |
| MAX. AIR FLOW | 8.304 (MIN. 7.474) M ³ /MIN. |
| (AT ZERO STATIC PRESSURE) | · · · · · · · · · · · · · · · · · · · |
| (AT ZERO STATIC PRESSURE) | 293.250 (MIN. 263.925) CFM |
| MAX. AIR PRESSURE | 65.278 (MIN. 52.883) mmH ₂ O |
| (AT ZERO AIRFLOW) | 2.570 (MIN. 2.082) inchH2O |
| ACOUSTICAL NOISE (AVG.) | 70.0 (MAX. 74.0) dB-A |
| INSULATION TYPE | UL: CLASS A |
| | 10 MEG OHM MIN. AT 500 VDC |
| INSULATION STRENGTH | (BETWEEN FRAME AND (+) TERMINAL) |
| | |
| DIELECTRIC STRENGTH | 5 mA MAX. AT 600 VAC 50/60 Hz 1.5 SECONDS, |
| BILLEO INTO OTTLENOTTI | (BETWEEN FRAME AND (+) TERMINAL) |
| | |


(continued) PAGE 1

DELTA MODEL: PFC1448HEE79

| LIFE EXPECTANCE (L10) (AT LABEL VOLTAGE) | 70,000 HOURS CONTINUOUS OPERATION AT 40 $^{\circ}$ C WITH 15 \sim 65 %RH. |
|---|---|
| ROTATION | CLOCKWISE VIEW FROM NAME PLATE SIDE. |
| LOCK ROTOR SHUT DOWN | THE CURRENT WILL SHUT DOWN, WHEN ROTOR LOCKED AND FIXED. |

NOTES:

- 1. ALL READINGS ARE MEASURED AFTER STABLY WARMING UP THROUGH 10 MINUTES.
- 2. STANDARD AIR PROPERTY IS AIR AT (Td) 25°C TEMPERATURE, (RH) 65% RELATIVE HUMIDITY, AND (Pb) 760 mmHg BAROMETRIC PRESSURE.
- 3. THE VALUES WRITTEN IN PARENS, (), ARE LIMITED SPEC.
- 4. ACOUSTICAL NOISE MEASURING CONDITION:

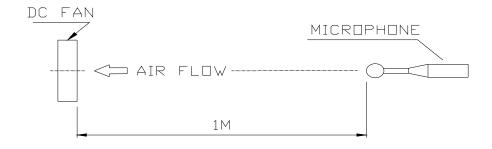

NOISE IS MEASURED AT RATED VOLTAGE IN FREE AIR IN SEMI-ANECHOIC CHAMBER WITH MICROPHONE AT A DISTANCE OF ONE METER FROM THE FAN INTAKE.

DELTA MODEL: PFC1448HEE79

3.MECHANICAL:

| 3-1. DIMENSIONS | SEE DIMENSIONS DRAWING |
|---------------------|------------------------|
| 3-2. FRAME | PLASTIC UL: 94V-0 |
| 3-3. IMPELLER | PLASTIC UL: 94V-0 |
| 3-4. BEARING SYSTEM | TWO BALL BEARINGS |
| 3-5. WEIGHT | 660 GRAMS (REF.) |

4. ENVIRONMENTAL:

| 4-1. OPERATING TEMPERATURE | |
|----------------------------|--------------|
| 4-2. STORAGE TEMPERATURE | |
| 4-3. OPERATING HUMIDITY | 5 TO 90 % RH |
| 4-4. STORAGE HUMIDITY | 5 TO 95 % RH |

5. PROTECTION:

- 5-1. LOCKED ROTOR PROTECTION
 IMPEDANCE OF MOTOR WINDING PROTECTS MOTOR FROM FIRE IN
 96 HOURS OF LOCKED ROTOR CONDITION AT THE RATED VOLTAGE.
- 5-2. POLARITY PROTECTION

 BE CAPABLE OF WITHSTANDING IF REVERSE CONNECTION FOR POSITIVE AND NEGATIVE LEADS.

6. RE OZONE DEPLETING SUBSTANCES:


6-1. NO CONTAINING PBBs, PBBOs, CFCs, PBBEs, PBDPEs AND HCFCs.

7. PRODUCTION LOCATION

7-1. PRODUCTS WILL BE PRODUCED IN CHINA OR THAILAND.


DELTA MODEL: PFC1448HEE79

8. P & Q CURVE:

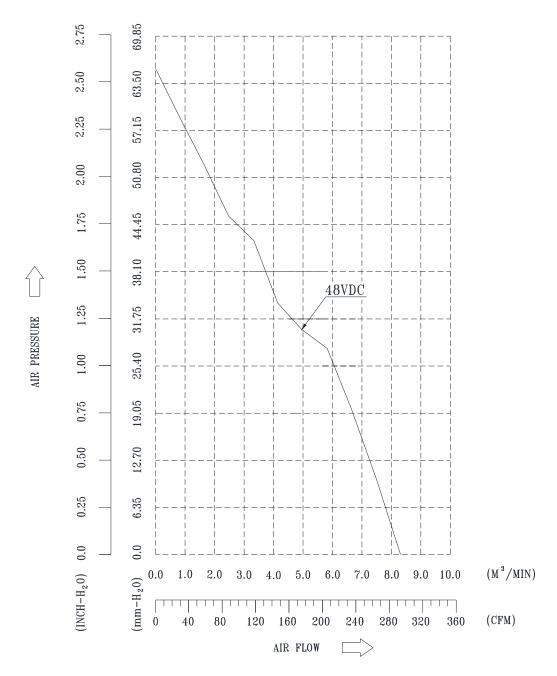

*TEST CONDITION: INPUT VOLTAGE-----OPERATION VOLTAGE
TEMPERATURE----ROOM TEMPERATURE
HUMIDITY----65%RH

DELTA MODEL: PFC1448HEE79

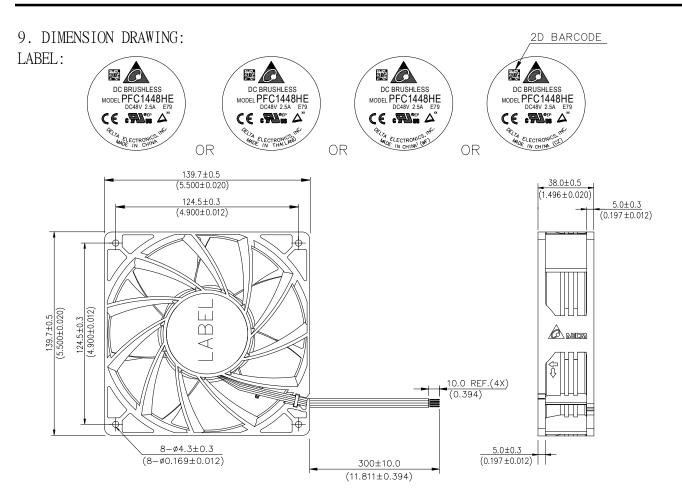

NOTES:


1. CABLE WIRE PIN ASSIGNMENT: (UL1061 AWG#22 AND 24)
BLACK WIRE --UL1061 AWG#22----(GND)
RED WIRE --UL1061 AWG#22----(+)
BLUE WIRE --UL1061 AWG#24----(PWM)
YELLOW WIRE ---UL1061 AWG#24----(F00)

2. THIS PRODUCT IS RoHS COMPLIANT

DELTA MODEL: PFC1448HEE79

10. FREQUENCY GENERATOR (FG) SIGNAL:

10-1. OUTPUT CIRCUIT - OPEN COLLECTOR MODE:

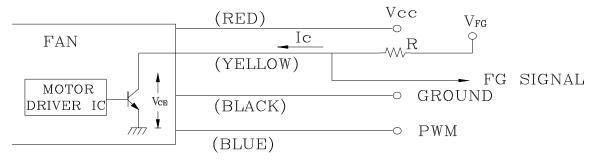


CAUTION: THE LEAD WIRE OF FG SIGNAL CAN NOT TOUCH THE LEAD WIRE OF POSITIVE OR NEGATIVE.

10-2. SPECIFICATION:

 $V_{CE}(sat) = 0.5V MAX.$ $V_{FG} = 60.0VDC MAX.$

 I_{C} = 5mA MAX. $R \ge V_{FG}/I_{C}$

10-3. FREQUENCY GENERATOR WAVEFORM:

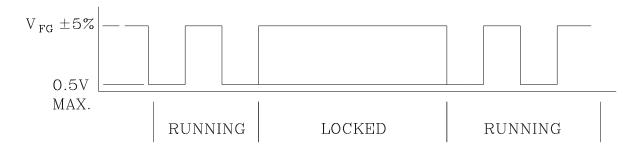

FAN RUNNING FOR FOO OUTPUT




N=R.P.M TS=60/N(SEC)
*VOLTAGE LEVEL AFTER BLADE LOCKED

DELTA MODEL: PFC1448HEE79

11. PWM CONTRON SIGNAL:

SIGNAL VOLTAGE RANGE: 0~15.0VDC

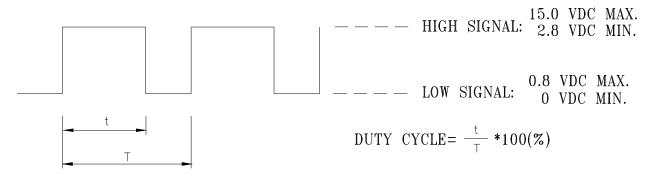

- THE PREFERRED OPERATING POINT FOR THE FAN IS 25k HZ, AND DUTY CYCLE FROM 0% TO 100%.
- AT 100% DUTY CYCLE, THE ROTOR WILL SPIN AT MAXIMUM SPEED.
- AT 0% DUTY CYCLE, THE ROTOR WILL SPIN AT MINIMUM SPEED.
- WITH CONTROL SIGNAL LEAD DISCONNECTED, THE FAN WILL SPIN AT MAXIMUM SPEED.

12. SPEED VS PWM CONTROL SIGNAL: (AT RATED VOLTAGE; 25 DEGREE C; PWM SIGNAL WITH 5 VDC TTL OR CMOS LEVELS & 25 KHZ)

| DUTY CYCLE (%) | SPEED R.P.M. | CURRENT (A) TYP. |
|----------------|--------------|------------------|
| 100 | 8000±10% | 1.1 |
| 50 | 4150±10% | 0.22 |
| 0 | 1700±300 | 0.06 |



Application Notice

- 1. Delta will not guarantee the performance of the products if the application condition falls outside the parameters set forth in the specification.
- 2. A written request should be submitted to Delta prior to approval if deviation from this specification is required.
- 3. Please exercise caution when handling fans. Damage may be caused when pressure is applied to the impeller, if the fans are handled by the lead wires, or if the fan was hard-dropped to the production floor.
- 4. Except as pertains to some special designs, there is no guarantee that the products will be free from any such safety problems or failures as caused by the introduction of powder, droplets of water or encroachment of insect into the hub.
- 5. The above-mentioned conditions are representative of some unique examples and viewed as the first point of reference prior to all other information.
- 6. It is very important to establish the correct polarity before connecting the fan to the power source. Positive (+) and Negative (-). Damage may be caused to the fans if connection is with reverse polarity, if there is no foolproof method to protect against such error specifically mentioned in this spec.
- 7. Delta fans without special protection are not suitable where any corrosive fluids are introduced to their environment.
- 8. Please ensure all fans are stored according to the storage temperature limits specified. Do not store fans in a high humidity environment. We highly recommend performance testing is conducted before shipping, if the fans have been stored over 6 months.
- 9. Not all fans are provided with the Lock Rotor Protection feature. If you impair the rotation of the impeller for the fans that do not have this function, the performance of those fans will lead to failure.
- 10. Please be cautious when mounting the fan. Incorrect mounting of fans may cause excess resonance, vibration and subsequent noise.
- 11. It is important to consider safety when testing the fans. A suitable fan guard should be fitted to the fan to guard against any potential for personal injury.
- 12. Except where specifically stated, all tests are carried out at room (ambient) temperature and relative humidity conditions of 25°C, 65% RH. The test value is only for fan performance itself.
- 13. Be certain to connect an " $4.7\mu F$ or greater" capacitor to the fan externally when the application calls for using multiple fans in parallel, to avoid any unstable power.

Doc. No: FMBG-ES Form 001 Rev. 0001 Date: June 24, 2009