









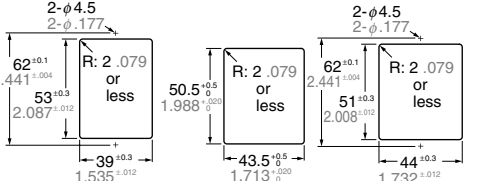









# COMPACT SIZE TIMER COMMON OPTIONS

## Flush Type

### 1. Flush type mounting frame

| Appearance   | Color       | Part number | Front View<br>(Installing onto<br>control panel)                                    | Mounting Hole Dimensions (Unit: mm inch)   |  |
|--|-------------|-------------|---|--|--|
|  |             |             |   | Recommended Hole<br>(For newly designed frame)   | Applicable Mounting Hole<br>(For installing in the old hole)   |
|    | Gray        | AT7851      |    | <br>*Distance between parallel drilled holes: 6.5 mm or more  | <br>*Distance between parallel drilled holes: 5 mm or more  |
|  | Black       | AT7852      |   |  |  |
|  | Silver Gray | AT7853      |   |  |  |
|    | Gray        | AT7811      |    | <br>*Distance between parallel drilled holes: 11 mm or more   |  |
|  | Black       | AT7812      |   |  |  |
|  | Silver Gray | AT7813      |   |  |  |
|   | Gray        | AT7821      |   | <br>*Distance between parallel drilled holes: 13 mm or more  | <br>*Distance between parallel drilled holes: 13 mm or more                        *Distance between parallel drilled holes: 8.5 mm or more                        *Distance between parallel drilled holes: 8 mm or more |
|  | Black       | AT7822      |   |  |  |
|  | Silver Gray | AT7823      |   |  |  |
|  | Gray        | AT7831      |  | <br>*Distance between parallel drilled holes: 21 mm or more |  |
|  | Gray        | AT7841      |  | <br>*Distance between parallel drilled holes: 8 mm or more  | <br>*Distance between parallel drilled holes: 16 mm or more   |


Notes:

- The thickness of all applicable panels ranges from 1.0 to 3.5 mm .039 to .138 inch.
- \* indicates the distance between the mounting holes which are parallel cut on the panel.

# COMPACT SIZE TIMER COMMON OPTIONS


## Installation

1. Insert the mounting frame surface into the panel from its front surface.





Note: The panel which is installed onto the flush type mounting frame for the timer cannot be inserted. (However, the installation order is not specified when the flush type mounting frame (type S) is used.)

2. After installing the panel, insert the timer to be used from the back of the panel.

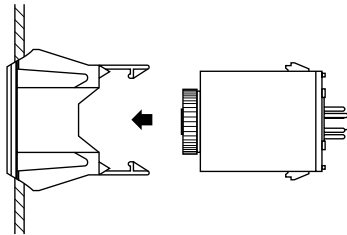

3. Hang the hooks on the timer base to secure the timer to the flush type mounting frame.

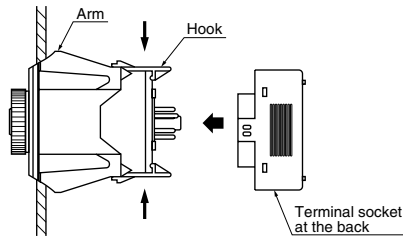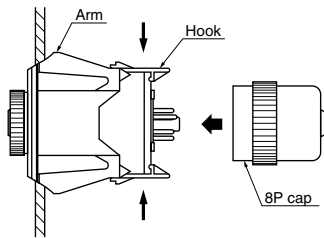

When an applicable timer comes in contact with the collar of the mounting frame, stop the timer by pressing the upper and lower hooks in the direction indicated by arrow. Use the terminal socket at the back (AT78041) or the 8P cap (AD8-RC) for the connection wiring.

## Removal

Remove the timer in the reverse order of installation.

## Compact timer protective cover




N-TC

### Features

1. The cover prevents the timer from operating improperly after setting the time. It also works as a compact dust cover.
2. The cover is applicable for all types of the fingertip flush type mounting frames for the compact timer.


## Installation

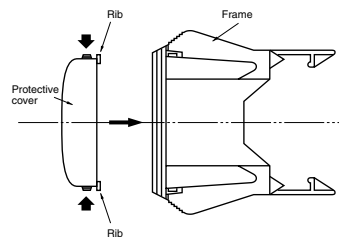

Press the points on the protective cover (indicated by arrows) to bend the ribs, and hook the ribs inside the mounting frame window. The protective cover can be installed if the timer is inserted into the mounting frame.


## Dimensions (Unit: mm, inch)

Tolerance:  $\pm 0.3 \pm .012$

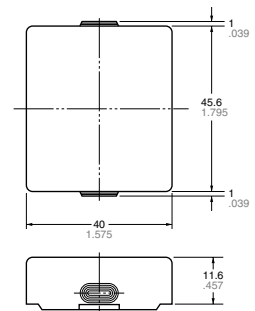


• **8P cap** When a flush type mounting frame is used for the exposed type, 8P cap should be installed.

### When installing 8P cap:



AD8-RC




The dimensions B and C are shown in the table below. (Unit: mm, inch)

| Mounting frame to be used        | Dimension B | Dimension C |
|----------------------------------|-------------|-------------|
| Type H<br>Type K                 | 13.1        | 52.8        |
| Type MHP<br>Type MHP-M<br>Type S | 14.6        | 51.3        |

• **Rear terminal socket: M3.5**

The terminal socket can be used for two installation methods for the back and the front!

Tolerance:  $\pm 0.1 \pm .004$



AT78041

# COMPACT SIZE TIMER COMMON OPTIONS

The protective cover is applicable for the exposed type plug-in and stand-up type timers (PMH, MHP-M, MHP)


## • Compact timer DIN terminal socket: M3.5

Tolerance:  $\pm 0.5 \pm .020$

When installing the terminal socket:


Mounting hole dimensions  
Without DIN rails

Wiring diagrams  
(TOP VIEW)





AT8-RFD

All types of our compact size timers can be easily installed on the DIN rail by using this terminal socket.



The height of the DIN rail should be added to the overall height A.

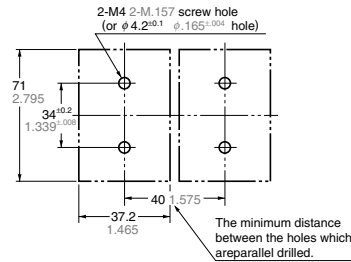

Note: Terminal number on the main body are identical to those on the terminal socket.


## • Compact size round terminal socket: M35

Tolerance:  $\pm 0.5 \pm .020$



Installing the terminal socket

Mounting hole dimensions

Wiring diagrams  
(TOP VIEW)



AT8-RFV

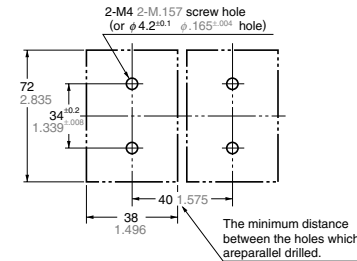

Note: Terminal number on the main body are identical to those on the terminal socket.

## • GT pipe socket


Tolerance:  $\pm 0.5 \pm .020$

## • Holding clip for stand-up GT pipe


Tolerance:  $\pm 1.0 \pm .039$

Installing the holding clip


Mounting hole dimensions




AW68102



AT7808



Use the M3 screws for installation.




**Pitch for installing the timer**  
When installing the clips vertically, the pitch for the timer should be 79 mm or more.

## • Mounting rail (Applicable for DIN, IEC standards)

## • Fastening plate



AT8-DLA1  
Length: 1 m  
Aluminum

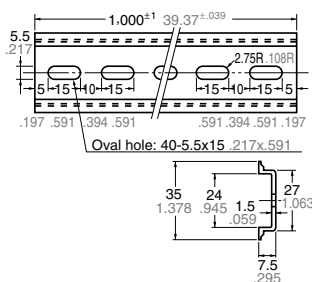

ATA4806

