

Monitoring Relays Frequency monitoring Type DFC01

CARLO GAVAZZI




- Over and under frequency monitoring relay
- Measures if power supply frequency is within set limits
- Measures on own power supply
- Separately adjustable upper/lower level on relative scale
- Separately adjustable delay functions (0.1 to 30 s)
- Output: 2 x 8 A SPDT relays
- For mounting on DIN-rail in accordance with DIN/EN 50 022
- 45 mm Euronorm housing
- LED indication for relays, alarm and power supply ON

Product Description

DFC01 is a precise frequency monitoring relay. It monitors its own power supply. Overfrequency and underfrequency can be monitored separately with two independent setpoints, delay times and relay outputs. The LED's indicate the state of the alarm and the output relay.

Ordering key

DFC 01 D B23

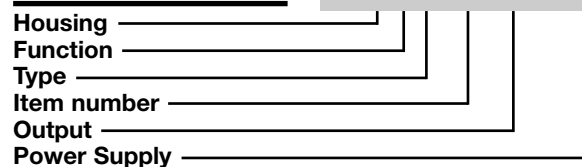

Type Selection

Mounting	Output	Supply: 24/48 VAC	Supply: 115/230 VAC
DIN-rail	2 x SPDT	DFC 01 D B48	DFC 01 D B23

Input Specifications

Input Own power supply	A1, A2 or A2, A3	
Measuring ranges Selectable by DIP-switches 2 Hz range	Upper level	Lower level
	50 Hz	47.8 to 49.8 Hz
	60 Hz	57.8 to 59.8 Hz
10 Hz range	Upper level	Lower level
	50 Hz	39 to 49 Hz
	60 Hz	49 to 59 Hz
Ranges	Upper frequency level	+10 to +110% of the selected range
	Lower frequency level	-110 to -10% of the selected range
Hysteresis (frequency)	2 Hz range	~ 0.05 Hz
	10 Hz range	~ 0.25 Hz

Output Specifications

Output Rated insulation voltage	2 x SPDT relays N.E. 250 VAC
Contact ratings (AgSnO ₂)	Resistive loads AC 1
	DC 12
	Small inductive loads AC 15
	DC 13
Mechanical life	≥ 30 x 10 ⁶ operations
Electrical life	≥ 10 ⁵ operations (at 8 A, 250 V, cos φ = 1)
Operating frequency	≤ 7200 operations/h
Dielectric strength	Dielectric voltage
	Rated impulse withstand volt.
	≥ 2 kVAC (rms) 4 kV (1.2/50 μs)

Supply Specifications

Power supply Rated operational voltage through terminals:	B48:
	B23:
	Overvoltage cat. III (IEC 60664, IEC 60038) A1, A2 or A3, A2 24/48 VAC ± 15% 40 to 70 Hz, insulated 115/230 VAC ± 15% 40 to 70 Hz, insulated
Rated operational power	5 VA

General Specifications

Power ON delay	1 s ± 0.5 s	Housing	
Accuracy	(15 min warm-up time)	Dimensions	45 x 80 x 99.5 mm
Temperature drift	± 1000 ppm/°C	Material	PA66 or Noryl
Delay ON alarm	± 10% on set value ± 50 ms	Weight	Approx. 220 g
Repeatability	± 0.5% on full-scale	Screw terminals	
Reaction time		Tightening torque	Max. 0.5 Nm acc. to IEC 60947
Frequency level		Product standard	EN 60255-6
Alarm ON delay:	< 200 ms (delay < 0.1 s)	Approvals	UL, CSA
Alarm OFF delay:	< 200 ms (delay < 0.1 s)	CE Marking	L.V. Directive 2006/95/EC EMC Directive 2004/108/EC
Indication for		EMC	
Power supply ON	LED, green	Immunity	According to EN 60255-26
Alarm ON	LED, red (flashing 2 Hz during delay time)	Emissions	According to EN 61000-6-2 According to EN 60255-26 According to EN 61000-6-3
Output relays ON	2 x LED, yellow		
Environment	(EN 60529)		
Degree of protection	IP 20		
Pollution degree	3		
Operating temperature	-20 to +60°C, R.H. < 95%		
Storage temperature	-30 to 80°C, R.H. < 95%		

Mode of Operation

DFC01 monitors the frequency value of its own power supply.

Example 1 (N.D. relay)

Both relays are OFF as soon as the frequency is above the lower setpoint and below the upper setpoint. When the measured frequency exceeds the upper set level for more than the set delay

time relay 1 is turned ON; if it drops below the lower set level for more than the set delay time relay 2 is turned ON. Each relay releases when the measured frequency comes back within its limits. The red LED flashes until the delay time has expired or the measured value falls off the limits.

Example 2 (N.E. relay)

The relay operates and the yellow LED is ON as long as the measured frequency is within the upper and lower limits.

Relay 1 releases in alarm position as soon as the measured frequency exceeds the upper set level for more than the set delay time; relay 2 releases as soon as the

measured frequency drops below the lower set level for more than the set delay time. The red LED flashes until the delay time has expired or the measured value comes back within the limits. Each relay is activated when the measured frequency comes back within its limits.

Function/Range/Level/Time Setting

Select the desired function setting the DIP-switches 1 to 6 as shown on the right. To access the DIP-switches open the plastic cover using a screwdriver as shown below.

Centre left knob:


Setting of upper frequency level on relative scale.

Centre right knob:

Setting of lower frequency level on relative scale.

Lower knobs:

Setting of delays on alarm time on absolute scale: 0.1 to 30 s.

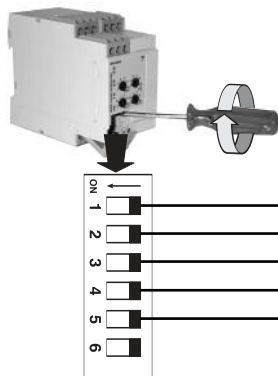

Output

ON: 2 x SPDT relays
OFF: 1 x DPDT relay

Relay working mode

ON: Normally De-energized
OFF: Normally Energized

Power ON delay

ON: 6 s ± 0.5 s
OFF: 1 s ± 0.5 s

System frequency


ON: 60 Hz
OFF: 50 Hz

Frequency setpoint range


ON: 2 Hz
OFF: 10 Hz

Operation Diagrams


Ex. 1

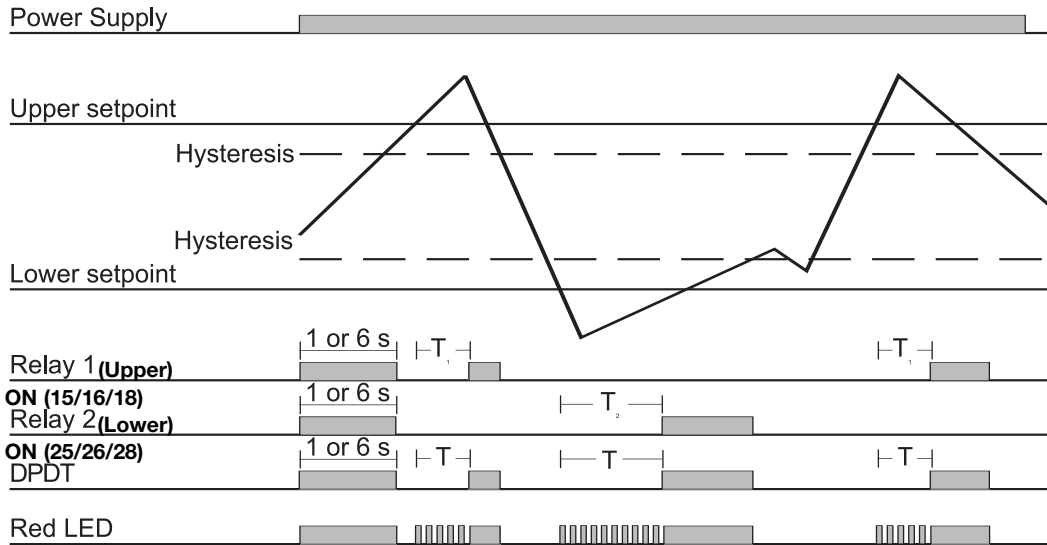

Ex. 2

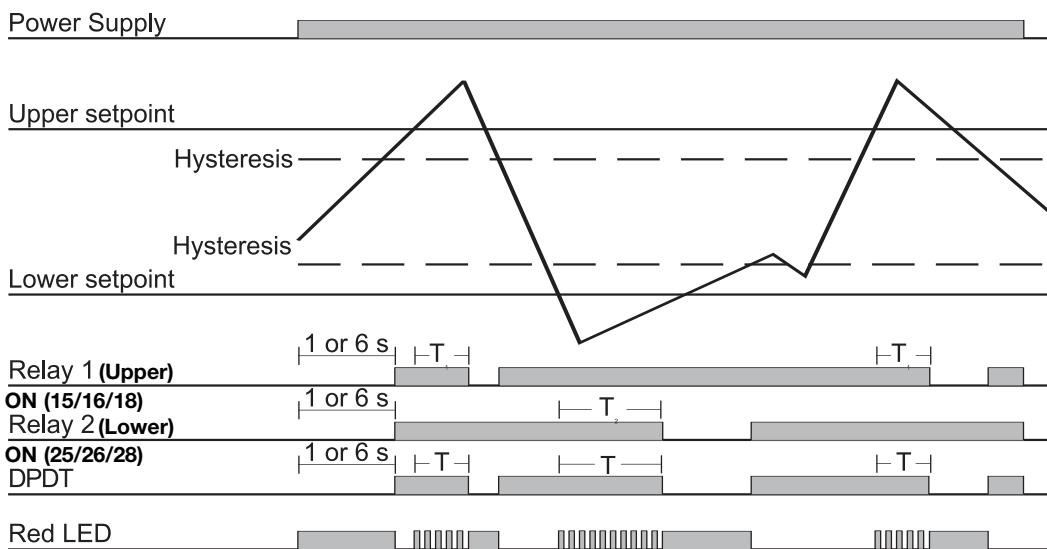

Wiring Diagram

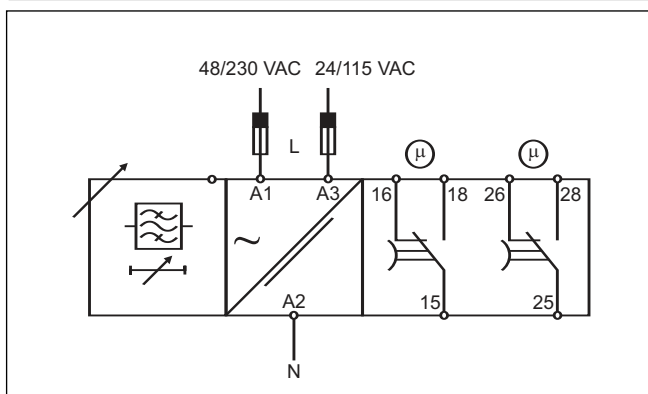

Dimensions

